

Standards EN62040-2: 2006

TEST REPORT

For

INVT POWER SYSTEM (SHENZHEN) CO., LTD.

Uninterruptible Power Systems

Model Number: HT31040X, HT33060X, HT33080X, HT33090X, HT33100X,
HT33120X

Prepared for : INVT POWER SYSTEM (SHENZHEN) CO., LTD.
Address : 5th Floor, 1# Building, Gaofa Industrial Park, Longjing,
Nanshan District, Shenzhen, China, 518055

Prepared by : EMTEK(SHENZHEN) CO., LTD..
Address : Bldg 69, Majialong Industry Zone,
Nanshan District, Shenzhen, Guangdong, China

Tel: (0755) 26954280
Fax: (0755) 26954282

Report Number : ES160523063E
Date of Test : June 05, 2015 to June 09, 2015
Date of Report : May 24, 2016

TABLE OF CONTENT

Description	Page
1. SUMMARY OF TEST RESULT.....	6
2. GENERAL INFORMATION.....	7
2.1. Description of Device (EUT).....	7
2.2. Description of Support Device.....	8
2.3. Description of Test Facility.....	9
2.4. Measurement Uncertainty.....	9
3. MEASURING DEVICE AND TEST EQUIPMENT.....	10
3.1. For Conducted Emission Measurement.....	10
3.2. For Radiated Emission Measurement.....	10
3.3. For Electrostatic Discharge Immunity Test.....	11
3.4. For RF Strength Susceptibility Test.....	11
3.5. For Electrical Fast Transient/Burst Immunity Test.....	11
3.6. For Surge Immunity Test.....	11
3.7. For Injected Current Susceptibility Test.....	12
3.8. For Magnetic Field Immunity Test.....	12
3.9. For Voltage Dips and Interruptions Test.....	12
4. CONDUCTED EMISSION MEASUREMENT.....	13
4.1. Block Diagram of Test Setup.....	13
4.2. Measuring Standard.....	13
4.3. Power Line Conducted Emission Limits (C3).....	13
4.4. EUT Configuration on Measurement.....	13
4.5. Operating Condition of EUT.....	14
4.6. Test Procedure.....	14
4.7. Measuring Results.....	14
5. RADIATED EMISSION MEASUREMENT.....	23
5.1. Block Diagram of Test.....	23
5.2. Measuring Standard.....	23
5.3. Radiated Emission Limits(C3).....	23
5.4. EUT Configuration on Test.....	24
5.5. Operating Condition of EUT.....	24
5.6. Test Procedure.....	24
5.7. Measuring Results.....	24
6. IMMUNITY PERFORMANCE CRITERIA DESCRIPTION.....	28
7. ELECTROSTATIC DISCHARGE IMMUNITY TEST.....	30
7.1. Block Diagram of Test Setup.....	30
7.2. Test Standard.....	30
7.3. Severity Levels and Performance Criterion.....	30
7.4. EUT Configuration.....	31
7.5. Operating Condition of EUT.....	31
7.6. Test Procedure.....	31
7.7. Test Results.....	31
8. RF FIELD STRENGTH SUSCEPTIBILITY TEST.....	33
8.1. Block Diagram of Test.....	33
8.2. Test Standard.....	33
8.3. Severity Levels and Performance Criterion.....	33
8.4. EUT Configuration on Test.....	34
8.5. Operating Condition of EUT.....	34
8.6. Test Procedure.....	34
8.7. Test Results.....	34
9. ELECTRICAL FAST TRANSIENT/BURST IMMUNITY TEST.....	36

9.1. Block Diagram of Test Setup.....	36
9.2. Test Standard.....	36
9.3. Severity Levels and Performance Criterion.....	36
9.4. EUT Configuration.....	37
9.5. Operating Condition of EUT.....	37
9.6. Test Procedure.....	37
9.7. Test Result.....	37
10. SURGE IMMUNITY TEST.....	39
10.1. Block Diagram of Test Setup.....	39
10.2. Test Standard.....	39
10.3. Severity Levels and Performance Criterion.....	39
10.4. EUT Configuration.....	40
10.5. Operating Condition of EUT.....	40
10.6. Test Procedure.....	40
10.7. Test Result.....	40
11. INJECTED CURRENTS SUSCEPTIBILITY TEST.....	42
11.1. Block Diagram of Test Setup.....	42
11.2. Test Standard.....	42
11.3. Severity Levels and Performance Criterion.....	42
11.4. EUT Configuration.....	43
11.5. Operating Condition of EUT.....	43
11.6. Test Procedure.....	43
11.7. Test Results.....	43
12. MAGNETIC FIELD SUSCEPTIBILITY TEST.....	45
12.1. Block Diagram of Test.....	45
12.2. Test Standard.....	45
12.3. Severity Levels and Performance Criterion.....	45
12.4. EUT Configuration on Test.....	46
12.5. Test Procedure.....	46
12.6. Test Results.....	46
13. VOLTAGE DIPS AND INTERRUPTIONS TEST.....	48
13.1. Block Diagram of Test Setup.....	48
13.2. Test Standard.....	48
13.3. Severity Levels and Performance Criterion.....	48
13.4. EUT Configuration.....	49
13.5. Operating Condition of EUT.....	49
13.6. Test Procedure.....	49
13.7. Test Result.....	49
14. TEST PHOTOGRAPH.....	51
14.1. Photos of Conducted Emission Measurement.....	51
14.2. Photo of Radiation Emission Measurement.....	52
14.3. Photo of Electrostatic Discharge Test.....	52
14.4. Photo of RF Field Strength susceptibility Test.....	53
14.5. Photos of Electrical Fast Transient/Burst Test.....	53
14.6. Photo of Surge Test.....	54
14.7. Photo of Injected Currents Susceptibility Test.....	54
14.8. Photo of Magnetic Field Immunity Test.....	55
14.9. Photo of Voltage dips and interruption Test.....	55

APPENDIX (Photos of EUT) (9 Pages)

TEST REPORT VERIFICATION

Applicant : INVT POWER SYSTEM (SHENZHEN) CO., LTD.
Manufacturer : INVT POWER SYSTEM (SHENZHEN) CO., LTD.
Trademark : INVT
EUT : Uninterruptible Power Systems
Model Number : HT31040X, HT33060X, HT33080X, HT33090X, HT33100X, HT33120X
Power Supply : Please refer to page 8

Measurement Procedure Used:

EN62040-2: 2006,
(IEC 61000-4-2:2008, IEC 61000-4-3:2006+A1:2007+A2:2010, IEC 61000-4-4:2012,
IEC 61000-4-5:2014, IEC 61000-4-6:2013, IEC 61000-4-8:2009, IEC 61000-4-11:2004)

The device described above is tested by EMTEK(SHENZHEN) CO., LTD.. to determine the maximum emission levels emanating from the device and the severe levels of the device can endure and its performance criterion. The measurement results are contained in this test report and EMTEK(SHENZHEN) CO., LTD.. is assumed full of responsibility for the accuracy and completeness of these measurements. Also, this report shows that the EUT (Equipment Under Test) is technically compliant with the EN 62040-2 requirements.

In this report the model and configuration chosen for each test is representative for all models or configurations (defined in the user manual) by using The "Worst Case" approach of the Guide for the EMC Directive 2004/108/EC (8th February 2010).

This report applies to above tested sample only and shall not be reproduced in part without written approval of EMTEK(SHENZHEN) CO., LTD..

Date of Test : June 05, 2015 to June 09, 2015

Prepared by : Bunny Zhang
Bunny Zhang/Editor

Reviewer : Jessie Hu
Jessie.Hu/Supervisor

Approved & Authorized Signer : Lisa Wang
Lisa Wang/Manager

Modified Information

Version	Report No.	Revision Date	Summary
Ver.1.0	ES150513113E	/	Original Report
Ver.1.0	ES160523063E	May 24, 2016	Update EMC directive and Standard

1. SUMMARY OF TEST RESULT

EMISSION			
Description of test item	Standard	Limits	Results
Conducted disturbance at mains terminals	EN62040-2: 2006	C3	Pass
Radiated Disturbance	EN62040-2: 2006	C3	Pass
Immunity			
Description of test item	Basic Standard	Performance Criteria	Results
Electrostatic Discharge (ESD)	IEC 61000-4-2:2008	B	Pass
Radio-frequency, Continuous radiated disturbance	IEC 61000-4-3:2006+A1:2007 +A2:2010	A	Pass
EFT/B Immunity	IEC 61000-4-4:2012	B	Pass
Surge Immunity	IEC 61000-4-5:2014	B	Pass
Conducted RF Immunity	IEC 61000-4-6:2013	A	Pass
Power frequency magnetic field	IEC 61000-4-8:2009	A	Pass
Voltage dips and Voltage interruptions	IEC 61000-4-11:2004	B	Pass
Note: /			

2. GENERAL INFORMATION

2.1. Description of Device (EUT)

EUT	: Uninterruptible Power Systems
Model Number	: HT31040X, HT33060X, HT33080X, HT33090X, HT33100X, HT33120X (Note: These models are identical in circuitry and electrical, mechanical and physical construction; the only differences are the output rating and model number. for trading purpose. We prepare HT33120X for test.)
Input Rating	: HT31040X: AC Input : 380/400/415VAC, 3ø+N+PE, 50Hz/60Hz, 58Amax, Batt Input: ±240Vdc, 80Amax HT33060X: AC Input : 380/400/415VAC, 3ø+N+PE, 50Hz/60Hz, 87Amax, Batt Input: ±240Vdc, 120Amax HT33080X: AC Input : 380/400/415VAC, 3ø+N+PE, 50Hz/60Hz, 116Amax, Batt Input: ±240Vdc, 160Amax HT33090X: AC Input : 380/400/415VAC, 3ø+N+PE, 50Hz/60Hz, 131Amax, Batt Input: ±240Vdc, 180Amax HT33100X: AC Input : 380/400/415VAC, 3ø+N+PE, 50Hz/60Hz, 145Amax, Batt Input: ±240Vdc, 200Amax HT33120X: AC Input : 380/400/415VAC, 3ø+N+PE, 50Hz/60Hz, 175Amax, Batt Input: ±240Vdc, 240Amax

Output Rating	: HT31040X: 220/230/240VAC, 1ø+N+PE, 50Hz/60Hz, 40kVA/36kW
	HT33060X: 380/400/415VAC, 3ø+N+PE, 50Hz/60Hz, 60kVA/54kW
	HT33080X: 380/400/415VAC, 3ø+N+PE, 50Hz/60Hz, 80kVA/72kW
	HT33090X: 380/400/415VAC, 3ø+N+PE, 50Hz/60Hz, 90kVA/81kW
	HT33100X: 380/400/415VAC, 3ø+N+PE, 50Hz/60Hz, 100kVA/90kW
	HT33120X: 380/400/415VAC, 3ø+N+PE, 50Hz/60Hz, 120kVA/108kW
Test voltage	: AC 380V/50Hz
Applicant	: INVT POWER SYSTEM (SHENZHEN) CO., LTD.
Address	: 5 th Floor, 1# Building, Gaofa Industrial Park, Longjing, Nanshan District, Shenzhen, China, 518055
Manufacturer	: INVT POWER SYSTEM (SHENZHEN) CO., LTD.
Address	: 5 th Floor, 1# Building, Gaofa Industrial Park, Longjing, Nanshan District, Shenzhen, China, 518055
Date of receiver	: June 05, 2015
Date of Test	: June 05, 2015 to June 09, 2015

2.2. Description of Support Device

N/A

2.3. Description of Test Facility

Site Description

EMC Lab. : Accredited by CNAS, 2013.10.29
 The certificate is valid until 2016.10.28
 The Laboratory has been assessed and proved to be in compliance with CNAS-CL01: 2006 (identical to ISO/IEC17025: 2005)
 The Certificate Registration Number is L2291.

Accredited by TUV Rheinland Guangzhou 2010.5.25
 The Laboratory has been assessed according to the requirements ISO/IEC 17025

Accredited by FCC, April 17, 2013
 The Certificate Registration Number. is 709623.

Accredited by Industry Canada, November 15, 2010
 The Certificate Registration Number. is 46405-4480

Name of Firm : EMTEK(SHENZHEN) CO., LTD.
 Site Location : Bldg 69, Majialong Industry Zone,
 Nanshan District, Shenzhen, Guangdong, China

2.4. Measurement Uncertainty

Test Item	Uncertainty
Conducted Emission Uncertainty	: 3.16dB(9k~150kHz Conduction 2#) 2.90dB(150k-30MHz Conduction 2#)
Radiated Emission Uncertainty (10m Chamber)	: 3.96dB (30M~1GHz Polarize: H) 4.04dB (30M~1GHz Polarize: V)
Uncertainty for C/S Test	: 1.45(Using CDN Test)
Uncertainty for R/S Test	: 2.10dB(80MHz-200MHz) 1.76dB(200MHz-1000MHz)
Uncertainty for test site temperature and humidity	: 0.6°C 4%

3. MEASURING DEVICE AND TEST EQUIPMENT

3.1. For Conducted Emission Measurement

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
<input checked="" type="checkbox"/>	Test Receiver	Rohde & Schwarz	ESCS30	828985/018	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	L.I.S.N.	Schwarzbeck	NNLK8129	8129-203	May 16, 2015	1 Year
<input type="checkbox"/>	L.I.S.N.	ROHDE & SCHWARZ	ESH3-Z6	100011	May 16, 2015	1 Year
<input type="checkbox"/>	L.I.S.N.	ROHDE & SCHWARZ	ESH3-Z6	100253	May 16, 2015	1 Year
<input type="checkbox"/>	L.I.S.N.	ROHDE & SCHWARZ	ESH3-Z5	100191	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	50Ω Coaxial Switch	Anritsu	MP59B	M20531	N/A	N/A
<input checked="" type="checkbox"/>	Pulse Limiter	Rohde & Schwarz	ESH3-Z2	100006	May 16, 2015	1 Year
<input type="checkbox"/>	Current probe	Rohde & Schwarz	EZ-17	0816.2063.02	May 16, 2015	1 Year

3.2. For Radiated Emission Measurement

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
<input checked="" type="checkbox"/>	EMI TEST RECEIVER	R&S/DE	ESR3	1316.300K03-1017 07-Z1 1316.3003K03-101 706-HN	May 16, 2015	1Year
<input type="checkbox"/>	EMI TEST RECEIVER	R&S/DE	ESCI3	1166.5950K03-101 384-Bw	May 16, 2015	1Year
<input type="checkbox"/>	Frequency Analyser	R&S/DE	FSV40	132.1.3008K39-10 0967-AP	May 16, 2015	1Year
<input checked="" type="checkbox"/>	Broadband Antenna(30M-3GHz)	Schwarzbeck/DE	VULP9163	659/660/661	May 16, 2015	1Year
<input type="checkbox"/>	Horn Antenna(1G-18GHz)	Schwarzbeck/DE	BBHA9120D	1177/1178	May 16, 2015	1Year
<input type="checkbox"/>	Horn Antenna (15G-26.5GHz)	Schwarzbeck/DE	BBHA9170	547	May 16, 2015	1Year
<input type="checkbox"/>	Horn Antenna (26.5G-40GHz)	AHS/USA	SAS-573	184/185	May 16, 2015	1Year
<input checked="" type="checkbox"/>	Pre-Amplifier (10M-1GHz 40dB)	Lunar EM	PM01-1-40	N/A	May 16, 2015	1Year
<input type="checkbox"/>	Pre-Amplifier (1G-18GHz 40dB)	Lunar EM	PM1-18-40	J101121229001	May 16, 2015	1Year
<input type="checkbox"/>	Pre-Amplifier (1G-18GHz 48dB)	Lunar EM	PM1-18-48	DS131115120D11 77	May 16, 2015	1Year
<input type="checkbox"/>	Pre-Amplifier (18G-26.5GHz 40dB)	Lunar EM	PM18-26-40	J1012131010001	May 16, 2015	1Year
<input type="checkbox"/>	Pre-Amplifier (18G-26.5GHz 48dB)	Lunar EM	PM18-26-48	J1013131010001	May 16, 2015	1Year
<input type="checkbox"/>	Pre-Amplifier (26.5G-40GHz 40dB)	Lunar EM	PM26-40-40	J1013131028001	May 16, 2015	1Year

3.3. For Electrostatic Discharge Immunity Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
<input checked="" type="checkbox"/>	ESD Tester	TESEQ AG	NSG 438A	130	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	Impulse Module	TESEQ AG	INA 4380-150pF/330Ohm	403-550/1712	May 16, 2015	1 Year

3.4. For RF Strength Susceptibility Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
<input checked="" type="checkbox"/>	Signal Generator	Agilent	N5181A	MY50145187	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	RF Power Meter. Dual Channel	BOONTON	4232A	10539	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	50ohm Diode Power Sensor	BOONTON	51011EMC	34236/34238	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	Field Strength Meter	DARE	RSS1006A	10I00037SO 22	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	50ohm Diode Power Sensor	BOONTON	51011EMC	36164	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	Power Amplifier	MILMEGA	80RF1000-175	1059345	May 16, 2015	1 Year
<input type="checkbox"/>	Power Amplifier	MILMEGA	AS0102-55	1018770	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	Power Amplifier	MILMEGA	AS1860-50	1059346	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	Log.-Per. Antenna	SCHWARZBECK	VULP 9118E	N/A	May 16, 2015	1 Year
<input type="checkbox"/>	Broad-Band Horn Antenna	SCHWARZBECK	STLP 9149	9149-227	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	Multi-function interface system	DARE	CTR1009B	12I00250SN O72	N/A	N/A
<input checked="" type="checkbox"/>	Automatic switch group	DARE	RSW1004A	N/A	N/A	N/A

3.5. For Electrical Fast Transient/Burst Immunity Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
<input checked="" type="checkbox"/>	Burst Tester	HAEFELY	PEFT4010	080981-16	May 16, 2015	1Year
<input type="checkbox"/>	Coupling Clamp	HAEFELY	IP-4A	147147	May 16, 2015	1Year
<input checked="" type="checkbox"/>	Three phase CDN	Teseq	CDN 163	202	May 16, 2015	1 Year

3.6. For Surge Immunity Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
<input checked="" type="checkbox"/>	Surge Controller	HAEFELY	Psurge 8000	174031	May 16, 2015	1Year
<input checked="" type="checkbox"/>	Impulse Module	HAEFELY	PIM 100	174124	May 16, 2015	1Year
<input checked="" type="checkbox"/>	Coupling Decoupling Filter	HAEFELY	PCD 130	172181	May 16, 2015	1Year
<input type="checkbox"/>	Coupling Module	HAEFELY	PCD122	174354	May 16, 2015	1Year
<input type="checkbox"/>	Surge Impulse Module	HAEFELY	PIM 120	174435	May 16, 2015	1Year
<input type="checkbox"/>	Coupling Module	HAEFELY	PCD 126A	174387	May 16, 2015	1Year
<input type="checkbox"/>	Impulse Module	HAEFELY	PIM 110	174391	May 16, 2015	1Year
<input type="checkbox"/>	Impulse Module	HAEFELY	PIM 150	178707	May 16, 2015	1Year

3.7. For Injected Current Susceptibility Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
<input checked="" type="checkbox"/>	Simulator	FRANKONIA	CIT-10	126B1210120 12	May 16, 2015	1Year
<input type="checkbox"/>	CDN	EMTEST	CDN-M2	5100100100	May 16, 2015	1Year
<input checked="" type="checkbox"/>	CDN	EMTEST	CDN-M3	0900-11	May 16, 2015	1Year
<input type="checkbox"/>	Injection Clamp	EMTEST	F-2031-23MM	368	May 16, 2015	1Year
<input checked="" type="checkbox"/>	Attenuator	EMTEST	ATT6	0010222A	May 16, 2015	1Year
<input type="checkbox"/>	Three phase CDN	Teseq	CDN M332S	32655	May 16, 2015	1 Year
<input type="checkbox"/>	Three phase CDN	Teseq	CDN M432S	33670	May 16, 2015	1 Year
<input type="checkbox"/>	Three phase CDN	Teseq	CDN M432-3LNS	34048	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	Three phase CDN	Teseq	CDN M532S	33799	May 16, 2015	1 Year

3.8. For Magnetic Field Immunity Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
<input checked="" type="checkbox"/>	Magnetic Field Tester	HAEFELY	MAG100	250040.1	May 16, 2015	1Year


3.9. For Voltage Dips and Interruptions Test

Used	Equipment	Manufacturer	Model No.	Serial No.	Last Cal.	Cal. Interval
<input checked="" type="checkbox"/>	45KVA AC Power source	Teseq/Germany	NSG 1007-45/45KVA	1305A02873	May 16, 2015	1 Year
<input type="checkbox"/>	Signal conditioning Unit	Teseq/Germany	CCN 1000-3	1305A02873	May 16, 2015	1 Year
<input type="checkbox"/>	Three phase impedance network	Teseq/Germany	INA2197/37A	1305A02873	May 16, 2015	1 Year
<input type="checkbox"/>	Three phase impedance network	Teseq/Germany	INA 2196/75A	1305A02874	May 16, 2015	1 Year
<input checked="" type="checkbox"/>	Proline 2100 AC Switching Unit	Teseq/Germany	NSG2200-3	A22714	May 16, 2015	1 Year

4. CONDUCTED EMISSION MEASUREMENT

4.1. Block Diagram of Test Setup

For AC Mains:

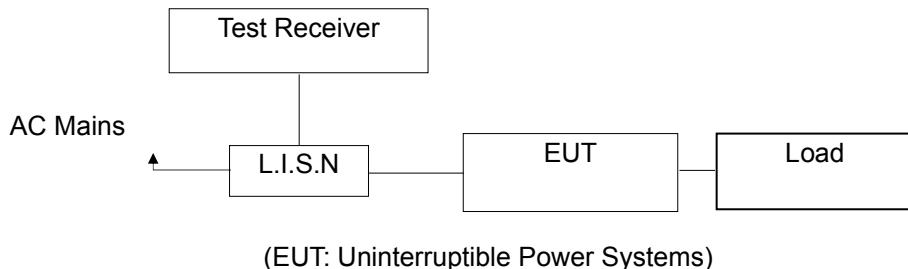

4.2. Measuring Standard

EN62040-2: 2006, Category C3

4.3. Power Line Conducted Emission Limits (C3)

UPS rated output current A	Frequency range MHz	Limits dB (μ V)	
		Quasi-peak	Average
>16 – 100	0,15 to 0,50 ^b	100	90
	0,50 to 5,0 ^b	86	76
	5,0 to 30,0	90 to 70 ^a	80 to 60 ^a
>100	0,15 to 0,50 ^b	130	120
	0,50 to 5,0 ^b	125	115
	5,0 to 30,0	115	105

^a The limits decrease linearly with the logarithm of the frequency.

^b The lower limit shall apply at the transition frequency.

4.4. EUT Configuration on Measurement

The following equipments are installed on Conducted Emission Measurement to meet EN 62040-2 requirements and operating in a manner which tends to maximize its emission characteristics in a normal application.

Uninterruptible Power Systems (EUT)
 Model Number : HT33120X
 Serial Number : N/A

4.5. Operating Condition of EUT

- 4.5.1. Setup the EUT as shown on Section 4.1.
- 4.5.2. Turn on the power of all equipments.
- 4.5.3. Let the EUT work in measuring mode (Line mode, Battery mode) and measure it.

4.6. Test Procedure


The EUT is put on the ground by insulating support and connected to the AC mains through Line Impedance Stability Network (L.I.S.N). This provided a 50ohm coupling impedance for the tested equipments. Both sides of AC line are investigated to find out the maximum conducted emission according to the EN62040-2 regulations during conducted emission measurement.
The bandwidth of the field strength meter (R&S Test Receiver ESCS30) is set at 9kHz in 150kHz~30MHz and 200Hz in 9kHz~150kHz.

The frequency range from 150kHz to 30MHz is investigated.

4.7. Measuring Results

PASS.

Please refer to the following pages.

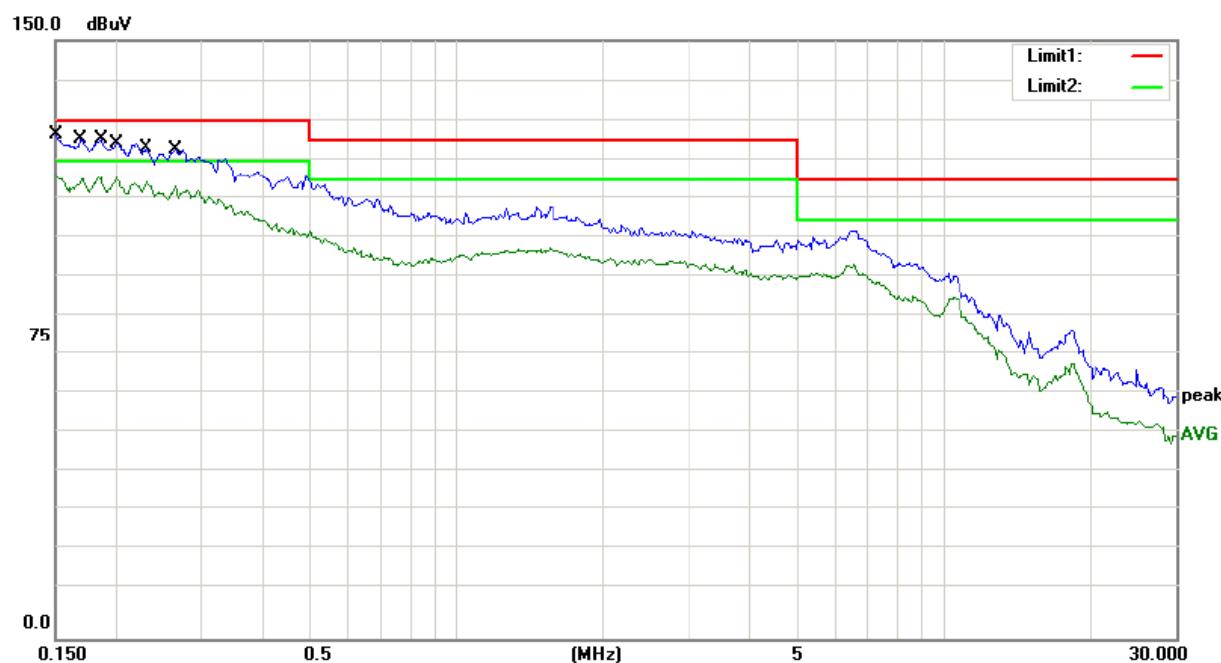

Site Conduction #2

Phase: **L1**

Temperature: 26

Limit: (CE)EN2040-2 C3_QP(>100A)

Power: AC 380V/50Hz


Humidity: 60 %

Mode: FULL LOAD

Note:

No.	Mk.	Freq.	Reading	Correct	Measure-	Limit	Over	Detector	Comment
			Level	Factor	ment				
		MHz	dBuV	dB	dBuV	dBuV	dB		
1		0.1500	125.20	0.00	125.20	130.00	-4.80	QP	
2 *		0.1500	116.08	0.00	116.08	120.00	-3.92	AVG	
3		0.1685	124.60	0.00	124.60	130.00	-5.40	QP	
4		0.1685	115.49	0.00	115.49	120.00	-4.51	AVG	
5		0.1853	124.20	0.00	124.20	130.00	-5.80	QP	
6		0.1853	115.54	0.00	115.54	120.00	-4.46	AVG	
7		0.1996	123.50	0.00	123.50	130.00	-6.50	QP	
8		0.1996	115.58	0.00	115.58	120.00	-4.42	AVG	
9		0.2291	123.13	0.00	123.13	130.00	-6.87	QP	
10		0.2291	114.62	0.00	114.62	120.00	-5.38	AVG	
11		0.2644	122.91	0.00	122.91	130.00	-7.09	QP	
12		0.2644	113.32	0.00	113.32	120.00	-6.68	AVG	

*:Maximum data x:Over limit !:over margin Comment: Factor build in receiver. Operator: SKY

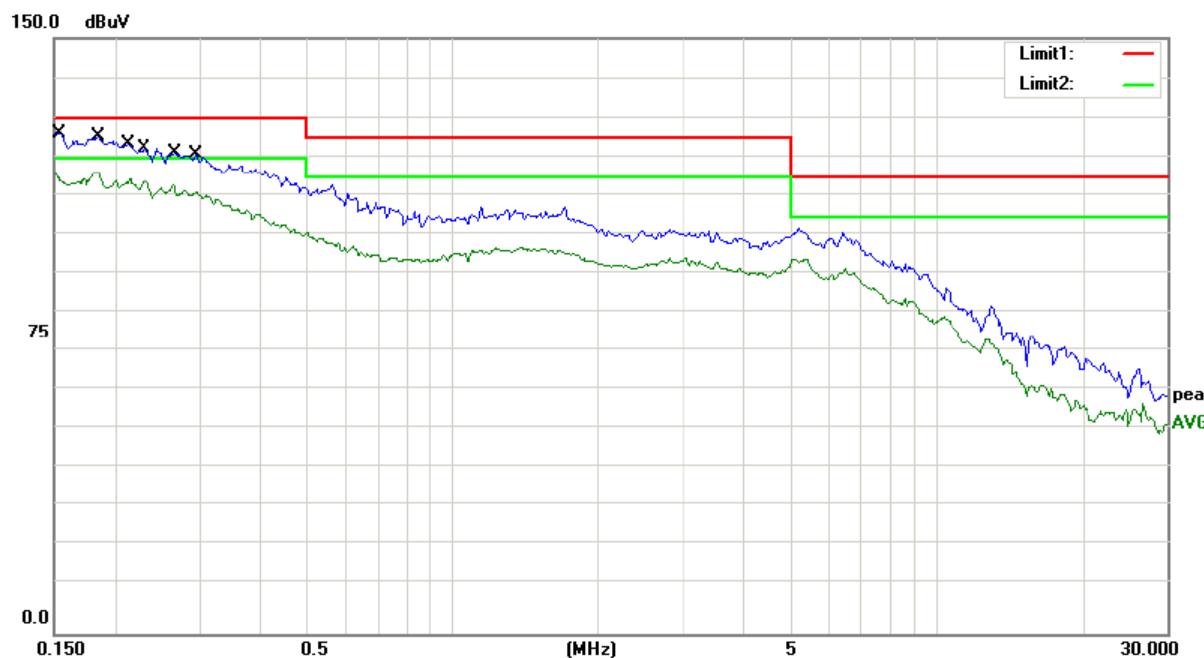

Site Conduction #2

Phase: **L2**

Temperature: 26

Limit: (CE)EN62040-2 C3_QP(>100A)

Power: AC 380V/50Hz


Humidity: 60 %

Mode: FULL LOAD

Note:

No.	Mk.	Freq. MHz	Reading Level	Correct Factor	Measure- ment	Limit	Over	Detector	Comment
			dBuV	dB	dBuV	dBuV	dB		
1		0.1500	125.40	0.00	125.40	130.00	-4.60	QP	
2		0.1500	116.42	0.00	116.42	120.00	-3.58	AVG	
3		0.1824	124.20	0.00	124.20	130.00	-5.80	QP	
4 *		0.1824	116.56	0.00	116.56	120.00	-3.44	AVG	
5		0.2127	123.50	0.00	123.50	130.00	-6.50	QP	
6		0.2127	114.55	0.00	114.55	120.00	-5.45	AVG	
7		0.2291	122.46	0.00	122.46	130.00	-7.54	QP	
8		0.2291	114.07	0.00	114.07	120.00	-5.93	AVG	
9		0.2658	121.29	0.00	121.29	130.00	-8.71	QP	
10		0.2658	113.11	0.00	113.11	120.00	-6.89	AVG	
11		0.2940	120.89	0.00	120.89	130.00	-9.11	QP	
12		0.2940	111.28	0.00	111.28	120.00	-8.72	AVG	

*:Maximum data x:Over limit !:over margin Comment: Factor build in receiver. Operator: SKY

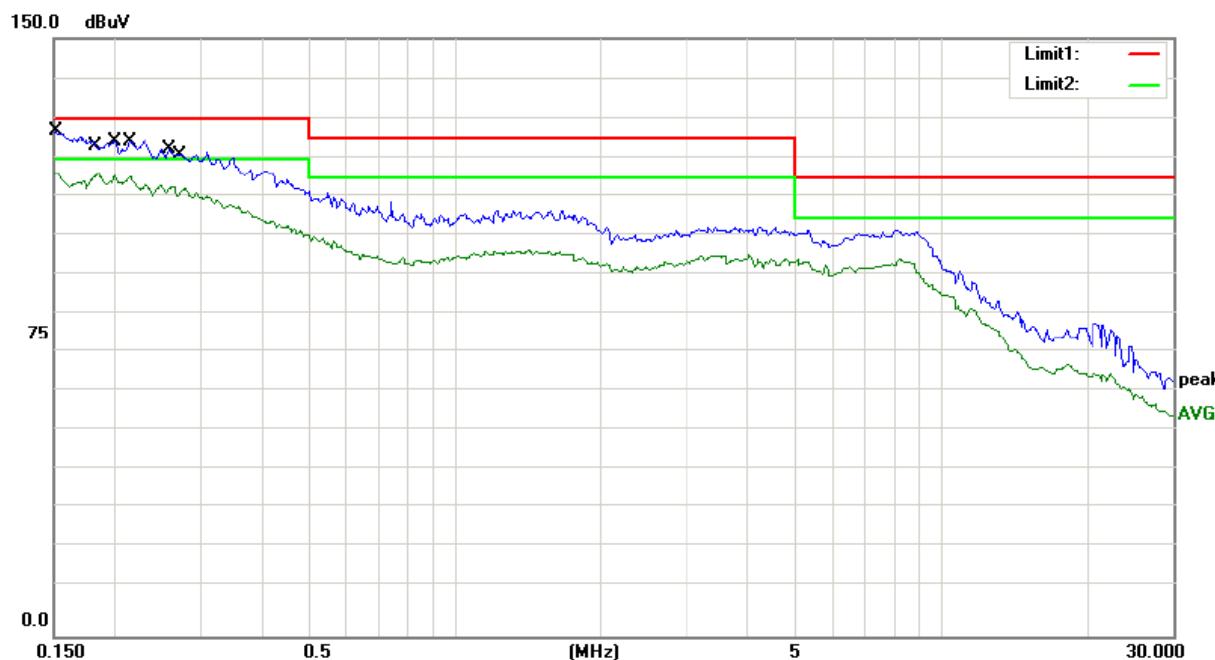

Site Conduction #2

Phase: **L3**

Temperature: 26

Limit: (CE)EN62040-2 C3_QP(>100A)

Power: AC 380V/50Hz


Humidity: 60 %

Mode: FULL LOAD

Note:

No.	Mk.	Freq. MHz	Reading Level	Correct Factor	Measure- ment	Limit	Over	Comment
			dBuV	dB	dBuV	dBuV	dB	
1		0.1500	125.40	0.00	125.40	130.00	-4.60	QP
2 *		0.1500	116.56	0.00	116.56	120.00	-3.44	AVG
3		0.1844	123.70	0.00	123.70	130.00	-6.30	QP
4		0.1844	116.30	0.00	116.30	120.00	-3.70	AVG
5		0.1996	122.90	0.00	122.90	130.00	-7.10	QP
6		0.1996	115.52	0.00	115.52	120.00	-4.48	AVG
7		0.2140	123.50	0.00	123.50	130.00	-6.50	QP
8		0.2140	115.47	0.00	115.47	120.00	-4.53	AVG
9		0.2587	122.32	0.00	122.32	130.00	-7.68	QP
10		0.2587	113.20	0.00	113.20	120.00	-6.80	AVG
11		0.2758	120.76	0.00	120.76	130.00	-9.24	QP
12		0.2758	112.34	0.00	112.34	120.00	-7.66	AVG

*:Maximum data x:Over limit l:over margin Comment: Factor build in receiver. Operator: SKY

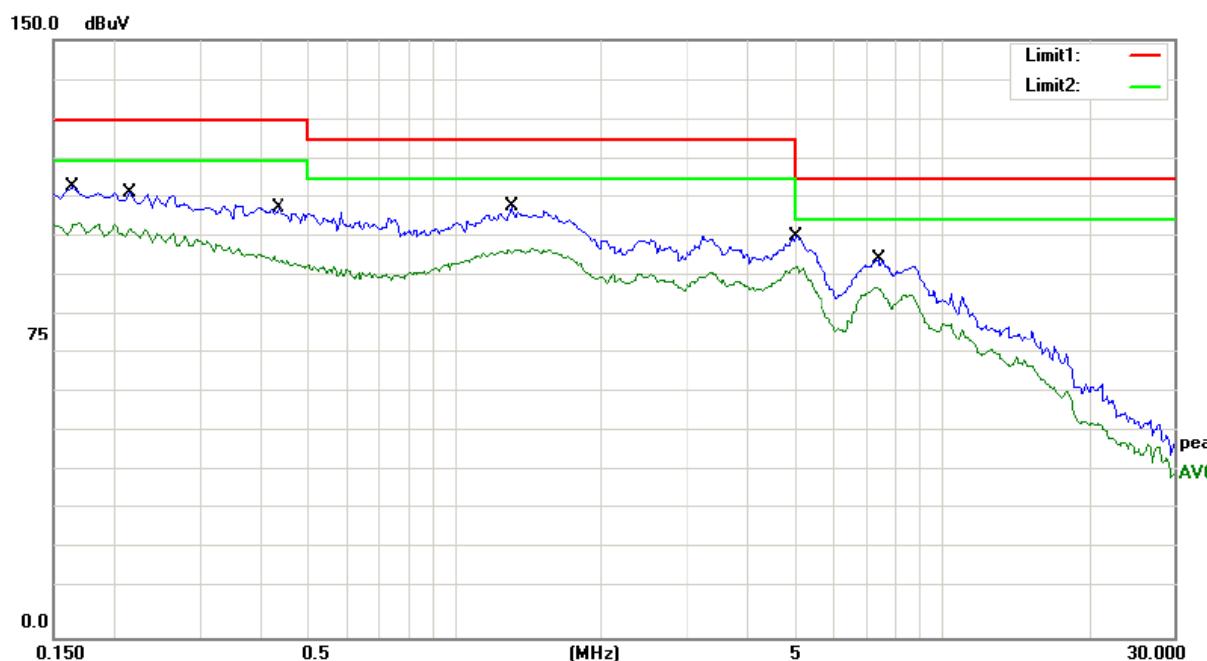

Site Conduction #2

Phase: **N**

Temperature: 26

Limit: (CE)EN62040-2 C3_QP(>100A)

Power: AC 380V/50Hz


Humidity: 60 %

Mode: FULL LOAD

Note:

No.	Mk.	Freq.	Reading	Correct	Measure-	Limit	Over	Detector	Comment
			Level	Factor	ment				
		MHz	dBuV	dB	dBuV	dBuV	dB		
1	0.1641	112.89	0.00	112.89	130.00	-17.11	QP		
2	0.1641	104.04	0.00	104.04	120.00	-15.96	AVG		
3	0.2140	111.67	0.00	111.67	130.00	-18.33	QP		
4	0.2140	103.54	0.00	103.54	120.00	-16.46	AVG		
5	0.4328	107.63	0.00	107.63	130.00	-22.37	QP		
6	0.4328	95.89	0.00	95.89	120.00	-24.11	AVG		
7	1.3030	108.08	0.00	108.08	125.00	-16.92	QP		
8	1.3030	97.63	0.00	97.63	115.00	-17.37	AVG		
9	5.0046	100.61	0.00	100.61	115.00	-14.39	QP		
10 *	5.0046	93.07	0.00	93.07	105.00	-11.93	AVG		
11	7.4071	95.25	0.00	95.25	115.00	-19.75	QP		
12	7.4071	88.00	0.00	88.00	105.00	-17.00	AVG		

*:Maximum data x:Over limit !:over margin Comment: Factor build in receiver. Operator: SKY

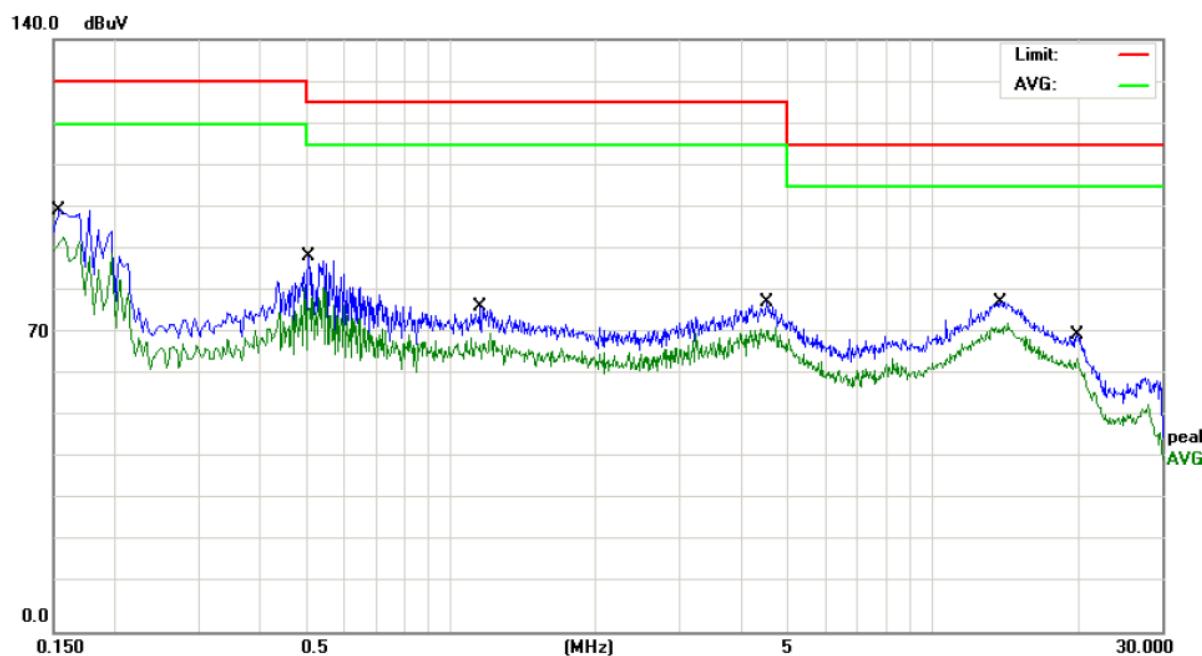

Site Chamber #1

Phase: **L1**

Temperature: 22

Limit: CE:EN 62040-2 (C3 >100A)_QP

Power: DC 480V

Humidity: 53 %


Mode: FULL LOAD

Note: BATTERY MODE

No.	Mk.	Freq. MHz	Reading Level dBuV	Correct Factor dB	Measure- ment dBuV	Limit dB	Over Detector	Over	
								Comment	
1		0.1540	77.96	20.00	97.96	130.0	-32.04	QP	
2 *		0.1540	71.23	20.00	91.23	120.0	-28.77	AVG	
3		0.5100	63.47	20.00	83.47	125.0	-41.53	QP	
4		0.5100	52.05	20.00	72.05	115.0	-42.95	AVG	
5		1.1580	51.60	20.00	71.60	125.0	-53.40	QP	
6		1.1580	45.39	20.00	65.39	115.0	-49.61	AVG	
7		4.5260	54.16	20.00	74.16	125.0	-50.84	QP	
8		4.5260	46.62	20.00	66.62	115.0	-48.38	AVG	
9		13.8540	53.62	20.00	73.62	115.0	-41.38	QP	
10		13.8540	49.13	20.00	69.13	105.0	-35.87	AVG	
11		19.9500	44.35	20.00	64.35	115.0	-50.65	QP	
12		19.9500	39.06	20.00	59.06	105.0	-45.94	AVG	

*:Maximum data x:Over limit !:over margin

(Reference Only)

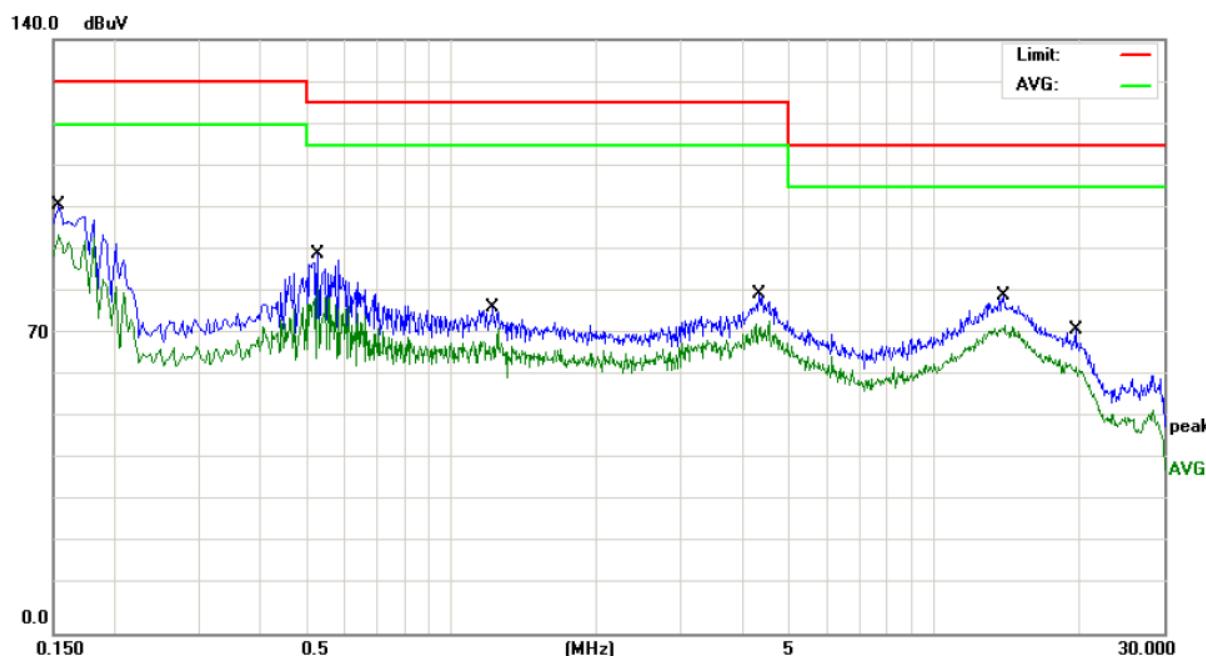

Site Chamber #1

Phase: **L2**

Temperature: 22

Limit: CE:EN 62040-2 (C3 >100A)_QP

Power: DC 480V

Humidity: 53 %


Mode: FULL LOAD

Note: BATTERY MODE

No.	Mk.	Freq. MHz	Reading Level dBuV	Correct Factor dB	Measure- ment dBuV	Limit dB	Over Detector	Comment
1		0.1540	77.96	20.00	97.96	130.0	-32.04	QP
2	*	0.1540	70.91	20.00	90.91	120.0	-29.09	AVG
3		0.5300	63.00	20.00	83.00	125.0	-42.00	QP
4		0.5300	52.90	20.00	72.90	115.0	-42.10	AVG
5		1.2180	50.94	20.00	70.94	125.0	-54.06	QP
6		1.2180	44.85	20.00	64.85	115.0	-50.15	AVG
7		4.3540	53.85	20.00	73.85	125.0	-51.15	QP
8		4.3540	46.08	20.00	66.08	115.0	-48.92	AVG
9		13.9540	53.77	20.00	73.77	115.0	-41.23	QP
10		13.9540	49.01	20.00	69.01	105.0	-35.99	AVG
11		19.7260	44.14	20.00	64.14	115.0	-50.86	QP
12		19.7260	38.77	20.00	58.77	105.0	-46.23	AVG

*:Maximum data x:Over limit !:over margin

(Reference Only)

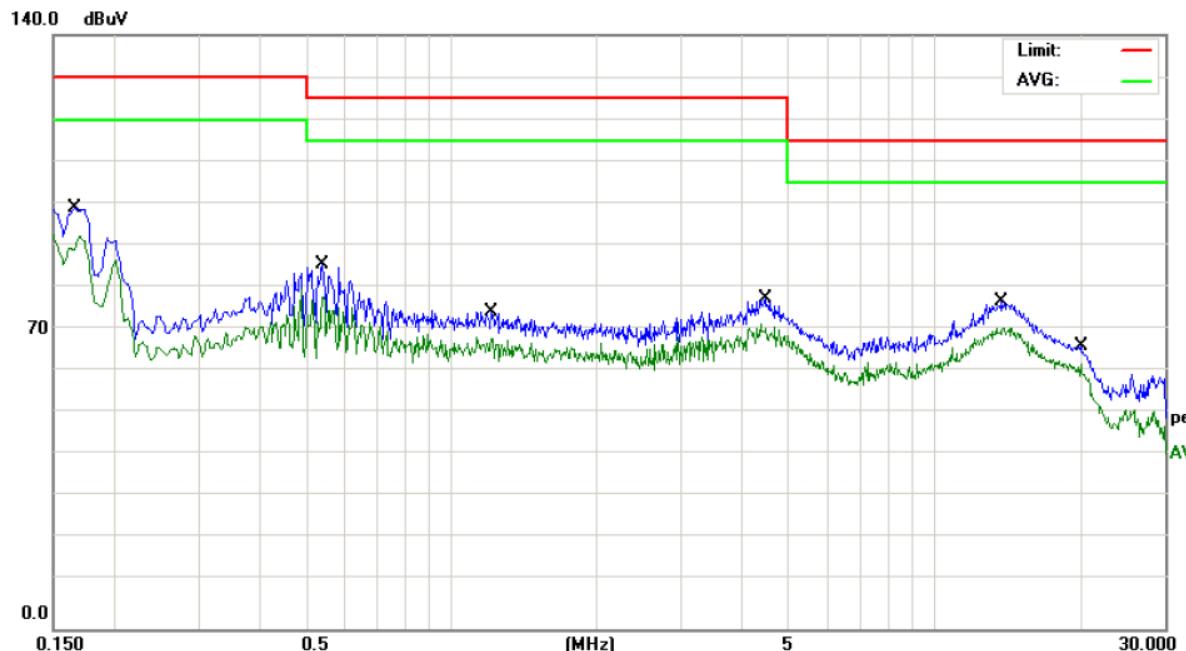

Site Chamber #1

Phase: **L3**

Temperature: 22

Limit: CE:EN 62040-2 (C3 >100A)_QP

Power: DC 480V

Humidity: 53 %


Mode: FULL LOAD

Note: BATTERY MODE

No. Mk.	Freq. MHz	Reading Level dBuV	Correct Factor dB	Measure- ment dBuV	Limit dB	Over Detector	Comment	
							Limit	Over
1	0.1660	76.10	20.00	96.10	130.0	-33.90	QP	
2	0.1660	65.82	20.00	85.82	120.0	-34.18	AVG	
3	0.5420	63.06	20.00	83.06	125.0	-41.94	QP	
4	0.5420	52.13	20.00	72.13	115.0	-42.87	AVG	
5	1.2140	51.63	20.00	71.63	125.0	-53.37	QP	
6	1.2140	45.08	20.00	65.08	115.0	-49.92	AVG	
7	4.4620	54.00	20.00	74.00	125.0	-51.00	QP	
8	4.4620	46.99	20.00	66.99	115.0	-48.01	AVG	
9	13.8020	52.60	20.00	72.60	115.0	-42.40	QP	
10	13.8020	47.89	20.00	67.89	105.0	-37.11	AVG	
11	20.1340	42.89	20.00	62.89	115.0	-52.11	QP	
12	20.1340	37.67	20.00	57.67	105.0	-47.33	AVG	

*:Maximum data x:Over limit !:over margin

(Reference Only)

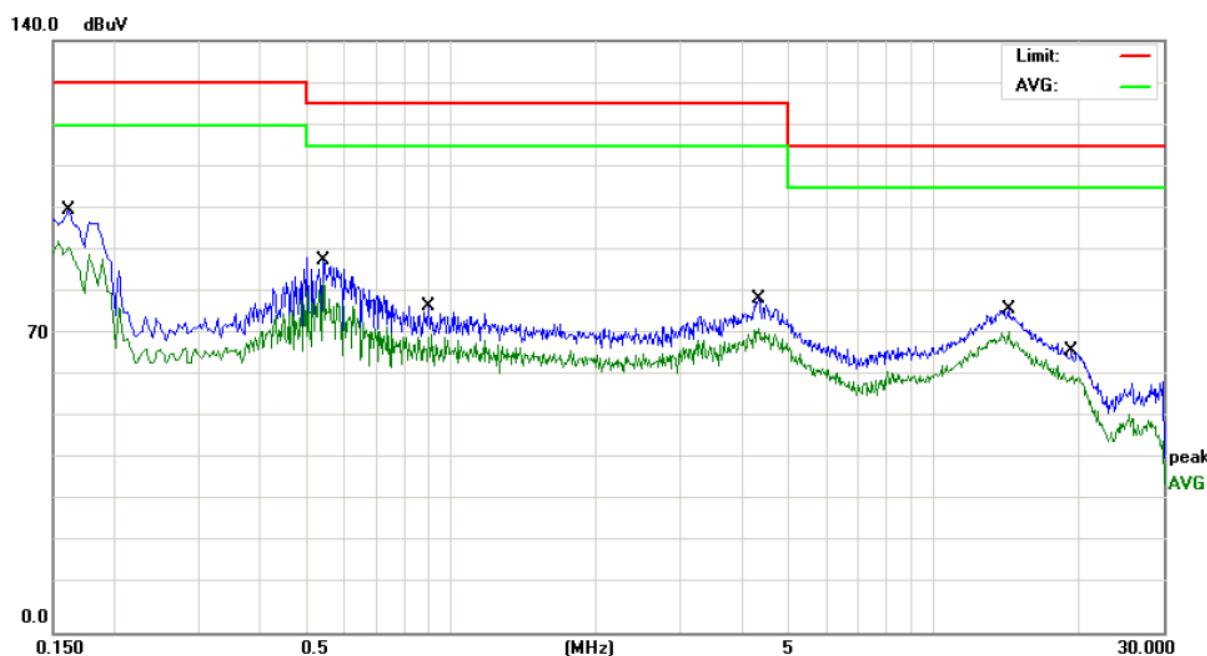

Site Chamber #1
Limit: CE:EN 62040-2 (C3 >100A)_QP
Mode: FULL LOAD
Note: BATTERY MODE

Phase: **N**

Temperature: 22

Power: DC 480V

Humidity: 53 %

No.	Mk.	Freq. MHz	Reading Level dBuV	Correct Factor dB	Measure- ment dBuV	Limit dB	Over Detector	Over	
								Comment	
1	0.1620	75.13	20.00	95.13	130.0	-34.87	QP		
2	0.1620	67.78	20.00	87.78	120.0	-32.22	AVG		
3	0.5460	64.65	20.00	84.65	125.0	-40.35	QP		
4	0.5460	54.61	20.00	74.61	115.0	-40.39	AVG		
5	0.9020	52.00	20.00	72.00	125.0	-53.00	QP		
6	0.9020	45.30	20.00	65.30	115.0	-49.70	AVG		
7	4.3540	53.08	20.00	73.08	125.0	-51.92	QP		
8	4.3540	46.12	20.00	66.12	115.0	-48.88	AVG		
9	14.3300	51.65	20.00	71.65	115.0	-43.35	QP		
10	14.3300	46.86	20.00	66.86	105.0	-38.14	AVG		
11	19.3980	41.29	20.00	61.29	115.0	-53.71	QP		
12	19.3980	36.26	20.00	56.26	105.0	-48.74	AVG		

*:Maximum data x:Over limit !:over margin

⟨Reference Only

5. RADIATED EMISSION MEASUREMENT


5.1. Block Diagram of Test

5.1.1. Block diagram of connection between the EUT and simulators



(EUT: Uninterruptible Power Systems)

5.1.2. Block diagram of test setup (In chamber)

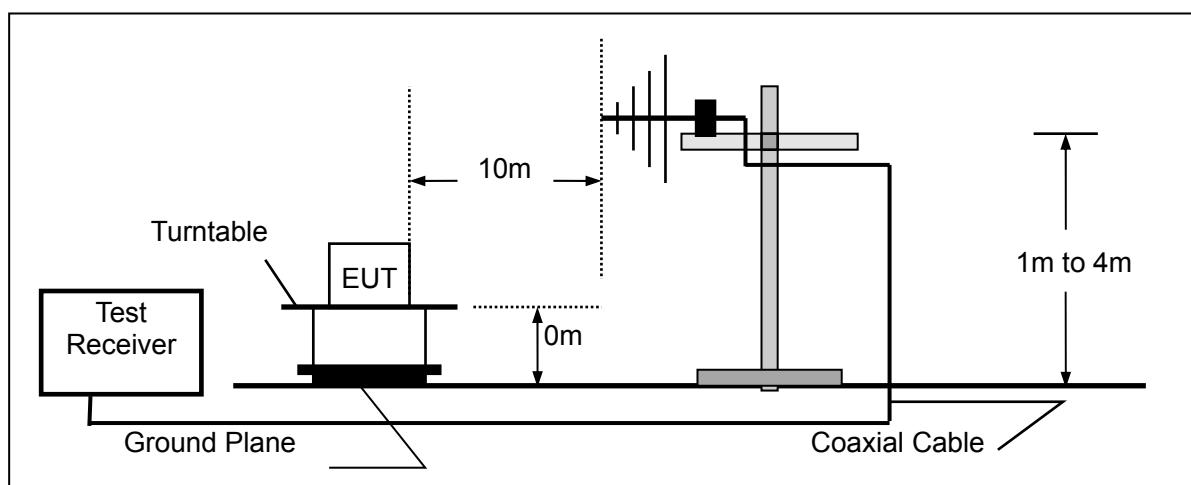

(EUT: Uninterruptible Power Systems)

5.2. Measuring Standard

EN62040-2: 2006 Category C3

5.3. Radiated Emission Limits(C3)

All emanations from a C3 device or system, including any network of conductors and apparatus connected thereto, shall not exceed the level of field strengths specified below:

FREQUENCY (MHz)	DISTANCE (Meters)	FIELD STRENGTHS LIMIT (dB μ V/m)
30 ~ 230	10	50
230 ~ 1000	10	57

Note: (1) The smaller limit shall apply at the combination point between two frequency bands.
(2) Distance refers to the distance in meters between the measuring instrument antenna and the closed point of any part of the EUT.

5.4. EUT Configuration on Test

The EN 62040-2 regulations test method must be used to find the maximum emission during radiated emission measurement.

5.5. Operating Condition of EUT

5.5.1. Turn on the power.

5.5.2. After that, let the EUT work in test mode (Line mode, Battery mode) and measure it.

5.6. Test Procedure

The EUT is placed on a turn table which is 0 meter high above the ground. The turn table can rotate 360 degrees to determine the position of the maximum emission level. The EUT is set 10 meters away from the receiving antenna which is mounted on a antenna tower. The antenna can be moved up and down from 1 to 4 meters to find out the maximum emission level. Biog antenna (calibrated by Dipole Antenna) is used as a receiving antenna. Both horizontal and vertical polarization of the antenna are set on test.

The bandwidth of the Receiver is set at 120kHz.

5.7. Measuring Results

PASS.

The frequency range from 30MHz to 1000MHz is investigated.


Radiated Emission Measurement

1. Settings

Data: 1

Start: 30MHz	Stop: 1GHz	
RBW: 100KHz	VBW: 300KHz	Ref: 80
RFAtt: 10	PreAmp: False	Polarization: Vertical
Tester: CSL	Model: HT33120X	Mode: FULL LOAD
Power:AC 380V/50Hz	Temperature:20	Humidity:53
Note:LINE MODE	Test Distance:10M	EUT:Uninterruptible Power Supply

2. Chart

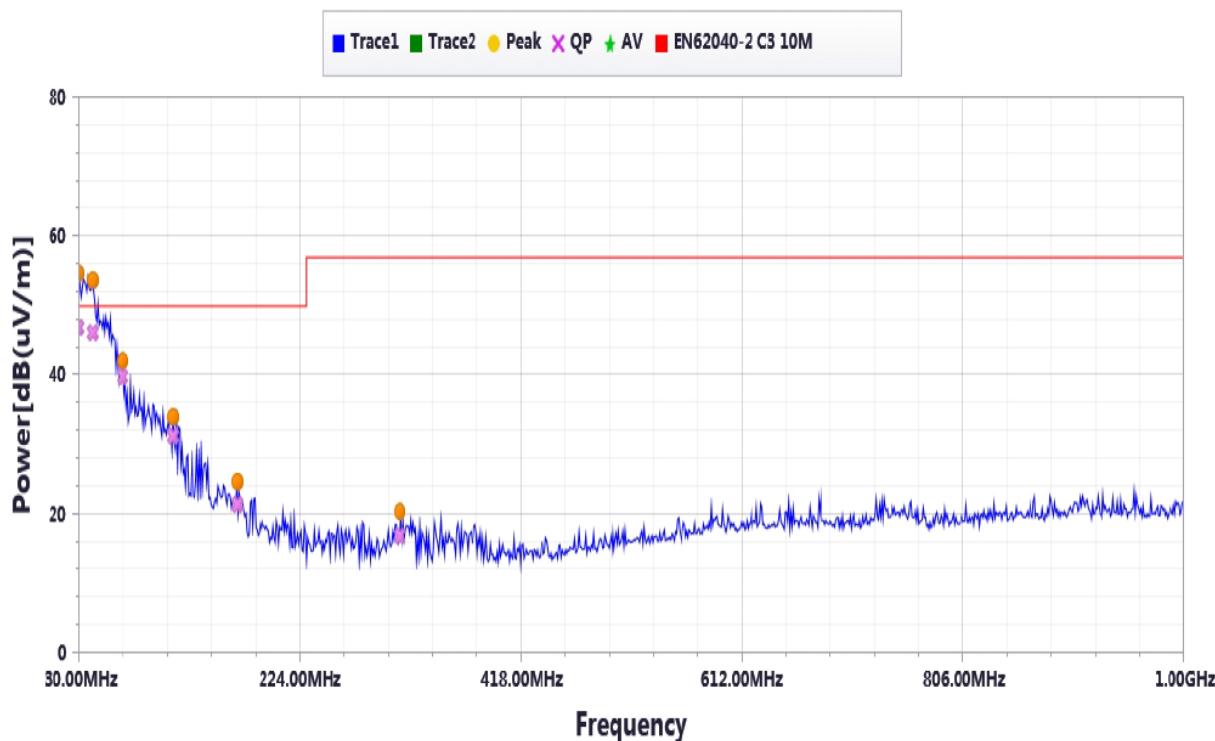

3. Result

No	Frequency	QP	Correct factor	Reading level	Limit1	Margin QP	Table Degree	Antenna Height	Result
	MHz	dB(uV/m)	dB	dB(uV)	dB(uV/m)	dB	Degree	cm	
1	30.48	46.9	-32.66	79.56	50	-3.1			Pass
2	42.11	46.3	-30.11	76.41	50	-3.7			Pass
3	68.28	39.8	-33.2	73	50	-10.2			Pass
4	112.85	31.2	-31.84	63.04	50	-18.8			Pass
5	169.06	21.5	-33.91	55.41	50	-28.5			Pass
6	312.47	16.9	-28.34	45.24	57	-40.1			Pass


Radiated Emission Measurement

1. Settings

Data: 1



Start: 30MHz	Stop: 1GHz	
RBW: 100KHz	VBW: 300KHz	Ref: 80
RFAtt: 10	PreAmp: False	Polarization: Horizontal
Tester: CSL	Model: HT33120X	Mode: FULL LOAD
Power:AC 380V/50Hz	Temperature:20	Humidity:53
Note:LINE MODE	Test Distance:10M	EUT:Uninterruptible Power Supply

2. Chart

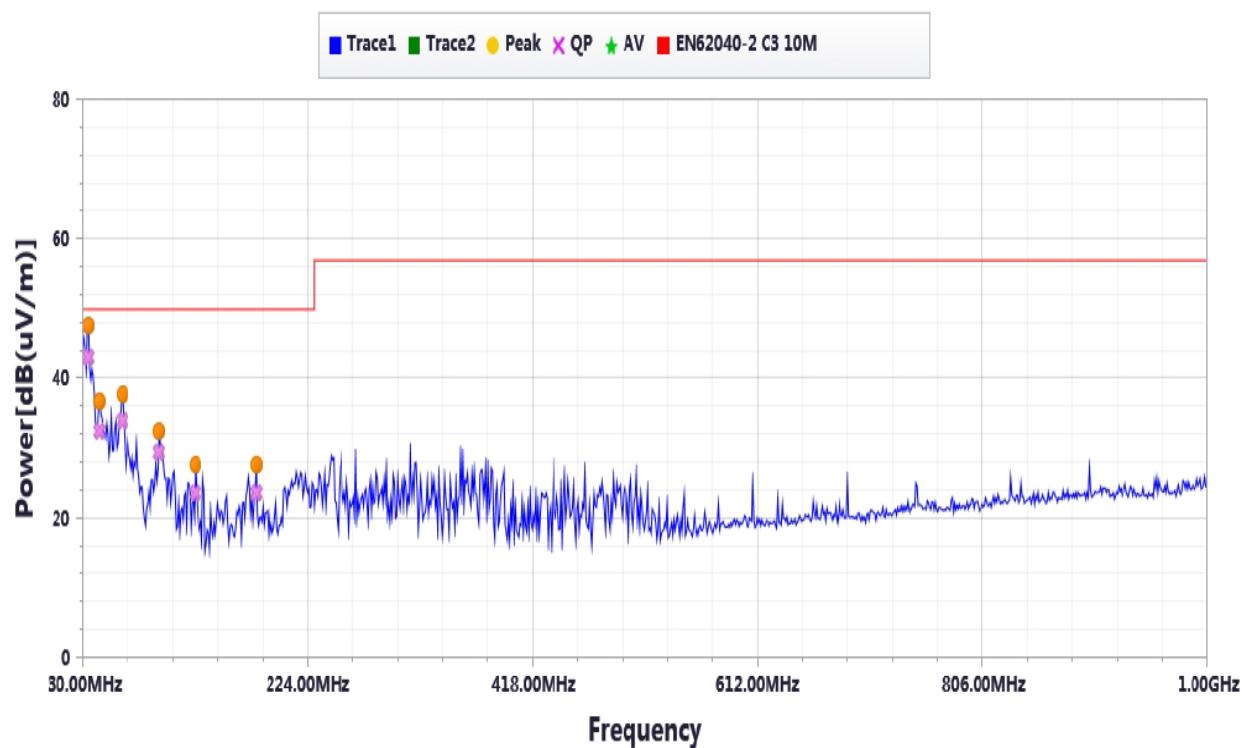

3. Result

No	Frequency	QP	Correct factor	Reading level	Limit1	Margin QP	Table Degree	Antenna Height	Result
	MHz	dB(uV/m)	dB	dB(uV)	dB(uV/m)	dB	Degree	cm	
1	35.33	43.2	-32.12	75.32	50	-6.8			Pass
2	45.02	32.5	-29.46	61.96	50	-17.5			Pass
3	64.40	34.1	-31.29	65.39	50	-15.9			Pass
4	96.38	29.5	-31.32	60.82	50	-20.5			Pass
5	127.39	23.7	-33.82	57.52	50	-26.3			Pass
6	179.72	23.6	-32.12	55.72	50	-26.4			Pass

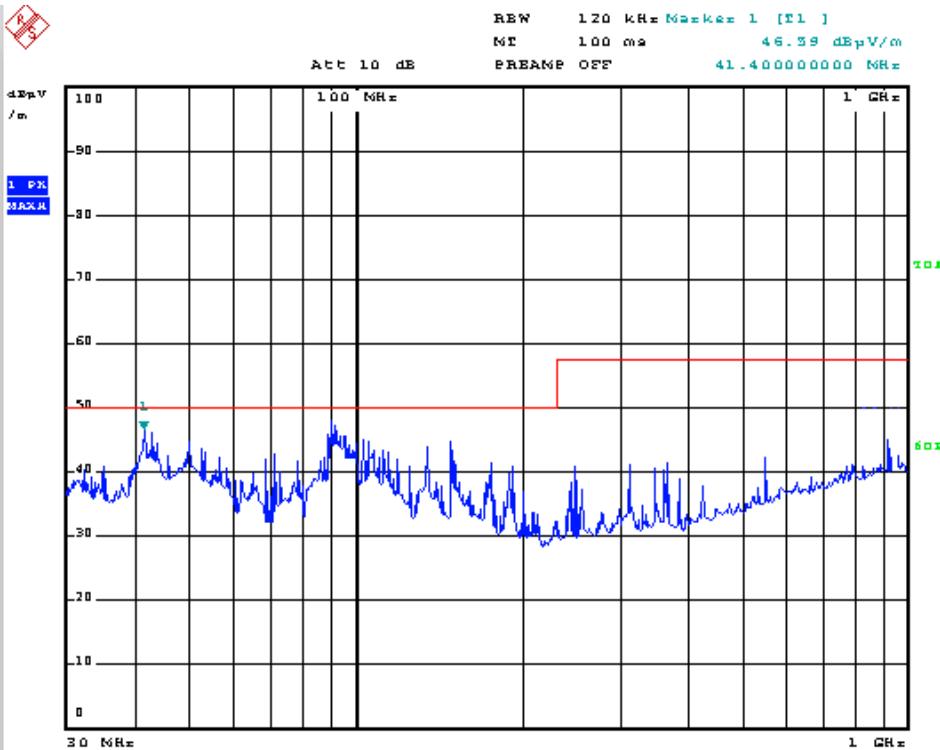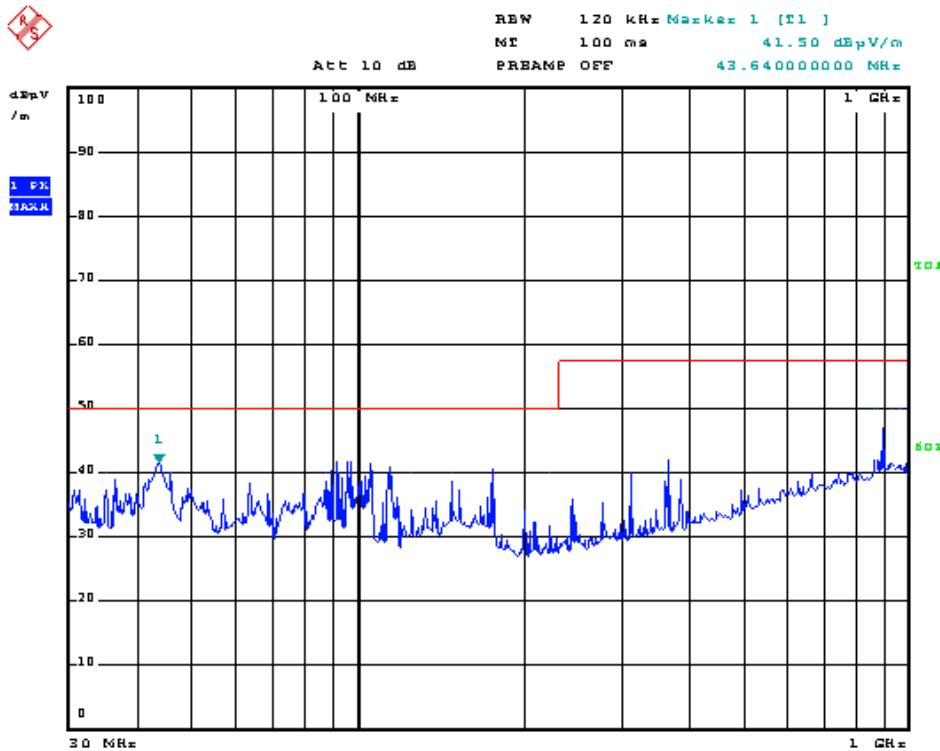

6. IMMUNITY PERFORMANCE CRITERIA DESCRIPTION

Performance Level

The test results shall be classified in terms of the loss of function or degradation of performance of the equipment under test, relative to a performance level by its manufacturer or the requestor of the test, or the agreed between the manufacturer and the purchaser of the product.

Definition related to the performance level:

1. Based on the used product standard
2. Based on the declaration of the manufacturer, requestor or purchaser

Criterion A:

Definition: normal performance within limits specified by the manufacturer, requestor and purchaser.

The equipment shall continue to operate as intended without operator intervention. No degradation of performance or loss of function is allowed below a performance level specified by the manufacturer when the equipment is used as intended. The performance level may be replaced by a permissible loss of performance. If the minimum performance level or the permissible performance loss is not specified by the manufacturer, then either of these may be derived from the product description and documentation, and by what the user may reasonably expect from the equipment if used as intended.

Criterion B:

Definition: temporary loss of function or degradation of performance which ceases after the disturbance ceases, and from which the equipment under test recovers its normal performance, without operator intervention.

After the test, the EUT shall continue to operate as intended without operator intervention. No degradation of performance or loss of function is allowed, after the application of the phenomena below a performance level specified by the manufacturer, when the EUT is used as intended. The performance level may be replaced by a permissible loss of performance. During the test, degradation of performance is allowed. However, no change of operating state or stored data is allowed to persist after the test. If the minimum performance level (or the permissible performance loss) is not specified by the manufacturer, then either of these may be derived from the product description and documentation, and by what the user may reasonably expect from the EUT if used as intended.

Criterion C:

Definition: temporary loss of function or degradation of performance, the correction of which requires operator intervention.

Loss of function is allowed, provided the function is self-recoverable, or can be restored by the operation of the controls by the user in accordance with the manufacturer's instructions. Functions, and/or information stored in non-volatile memory, or protected by a battery backup, shall not be lost.

Criterion D

Definition: loss of function or degradation of performance, which is not recoverable, owing to damage to hardware or software, or loss of data.

7. ELECTROSTATIC DISCHARGE IMMUNITY TEST


7.1. Block Diagram of Test Setup

7.1.1. Block diagram of connection between the EUT and simulators



(EUT: Uninterruptible Power Systems)

7.1.2. Block diagram of ESD test setup

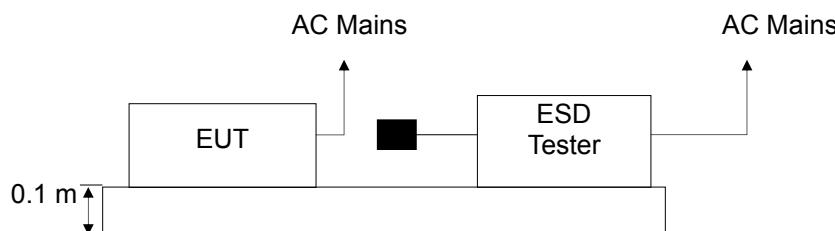

(EUT: Uninterruptible Power Systems)

7.2. Test Standard

IEC 61000-4-2:2008 (Air Discharge: $\pm 8\text{kV}$, Contact Discharge: $\pm 4\text{kV}$)

7.3. Severity Levels and Performance Criterion

7.3.1. Severity level

Level	Test Voltage Contact Discharge (kV)	Test Voltage Air Discharge (kV)
1.	± 2	± 2
2.	± 4	± 4
3.	± 6	± 8
4.	± 8	± 15
X	Special	Special

7.3.2.Performance criterion : B

	Criterion B
Output characteristics	Voltage permitted to vary within the inverse time characteristics applicable (<100 m sec limits in Figures 1, 2 or 3 of IEC 62040-3)
External and internal indications and metering	Change only during test
Control signals to external devices	Change only temporarily in consistency with the actual Uninterruptible Power Systems mode of operation
Mode of operation	Change only temporarily

7.4. EUT Configuration

The configuration of EUT are listed in Section 4.3.

7.5. Operating Condition of EUT

Same as conducted emission measurement, which is listed in Section 4.4. except the test set up replaced by Section 7.1.

7.6. Test Procedure

7.6.1.Air Discharge:

This test is done on a non-conductive surface. The round discharge tip of the discharge electrode shall be approached as fast as possible to touch the EUT.

After each discharge, the discharge electrode shall be removed from the EUT.

The generator is then re-triggered for a new single discharge and repeated 10 times for each pre-selected test point. This procedure shall be repeated until all the air discharge completed

7.6.2.Contact Discharge:

All the procedure shall be same as Section 7.6.1. except that the tip of the discharge electrode shall touch the EUT before the discharge switch is operated.

7.6.3.Indirect discharge for horizontal coupling plane

At least 10 single discharges(in the most sensitive polarity) shall be applied at the front edge of each HCP opposite the center point of each unit(if applicable) of the

EUT and 0.1m from the front of the EUT. The long axis of the discharge electrode shall be in the plane of the HCP and perpendicular to its front edge during the discharge.

7.6.4.Indirect discharge for vertical coupling plane

At least 10 single discharge (in the most sensitive polarity) shall be applied to the center of one vertical edge of the coupling plane. The coupling plane, of dimensions 0.5m X 0.5m, is placed parallel to, and positioned at a distance of 0.1m from the EUT. Discharges shall be applied to the coupling plane, with this plane in sufficient different positions that the four faces of the EUT are completely illuminated.

7.7. Test Results

PASS

Please refer to the following page.

Electrostatic Discharge Test Result

EMTEK(SHENZHEN) CO., LTD.

Applicant	: INV POWER SYSTEM (SHENZHEN) CO., LTD.	Test Date	: June 09, 2015
EUT	: Uninterruptible Power Systems	Temperature	: 22°C
M/N	: HT33120X	Humidity	: 50%
Power Supply	: AC 380V/50Hz	Actual Criterion	: B
Test Mode	: Line mode, Battery mode	Air discharge	: ±8kV
Test Engineer	: YU	Contact discharge	: ±4kV
Location		Kind A-Air Discharge C-Contact Discharge	Result
Screen		A	A
Button		A	A
Screw		C	A
Metal		C	A
HCP		C	A
VCP of front		C	A
VCP of rear		C	A
VCP of left		C	A
VCP of right		C	A
Test Equipment: ESD Simulator (TESEQAG, NSG 437)			

8. RF FIELD STRENGTH SUSCEPTIBILITY TEST


8.1. Block Diagram of Test

8.1.1. Block diagram of connection between the EUT and Load



(EUT: Uninterruptible Power Systems)

8.1.2. Block diagram of RS test setup

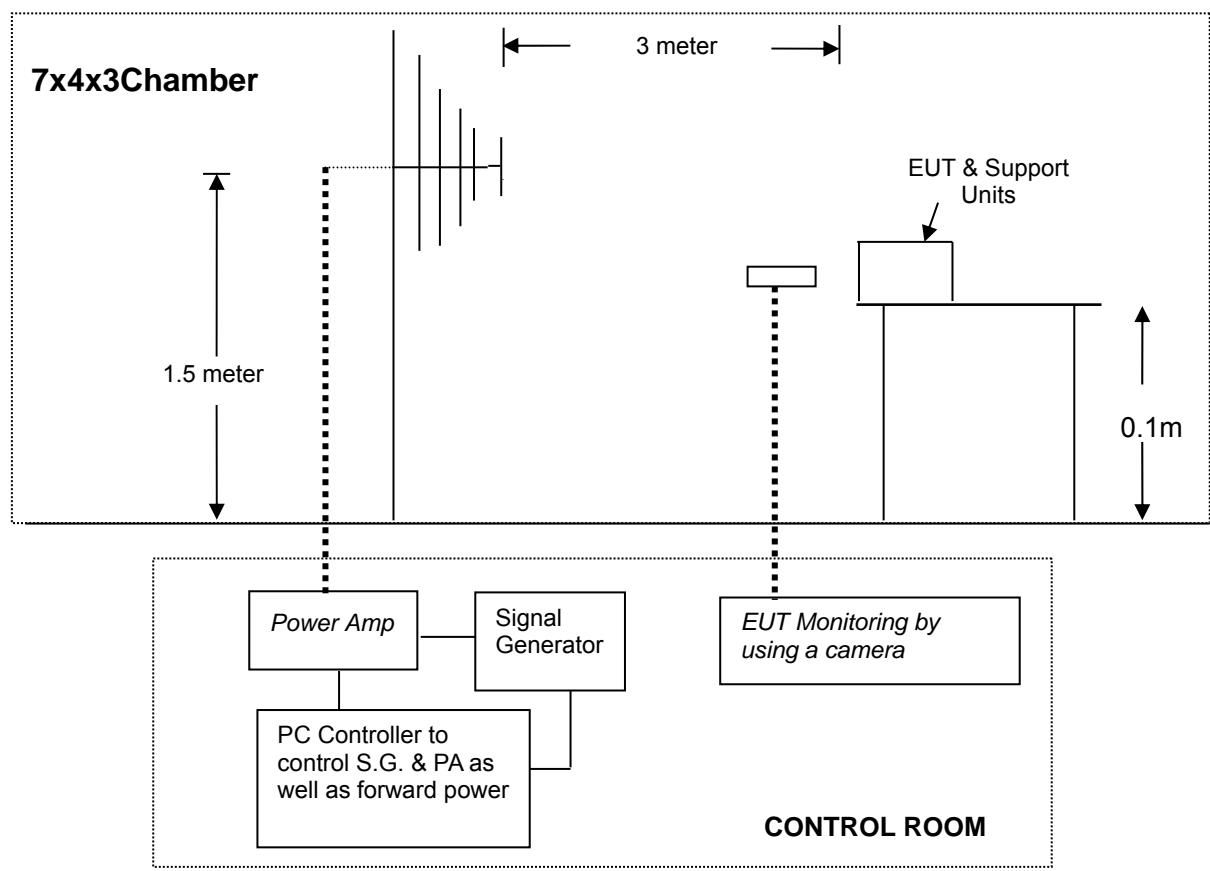

(EUT: Uninterruptible Power Systems)

8.2. Test Standard

IEC 61000-4-3:2006+A1:2007+A2:2010 (level 3: 10V / m)

8.3. Severity Levels and Performance Criterion

8.3.1. Severity Levels

Level	Field Strength V/m

1.	1
2.	3
3.	10
X	Special

8.3.2. Performance Criterion : A

	Criterion A
External and internal indications and metering (LCD)	No change
Output characteristics (Load)	No change
Control signals to external devices (Signal line)	No change
Mode of operation	No change

8.4. EUT Configuration on Test

The configuration of the EUT is same as Section 4.3.

8.5. Operating Condition of EUT

Same as radiated emission measurement which is listed in Section 4.4, except the test setup replaced as Section 8.1.

8.6. Test Procedure

The EUT is placed on a table which is 0.1m high above the ground. The EUT is set 3 meters away from the transmitting antenna which is mounted on an antenna tower. Both horizontal and vertical polarization of the antenna are set on test. Each of the four sides of the EUT must be faced this transmitting antenna and measured individually.

In order to judge the EUT performance, a CCD camera is used to monitor its screen.
All the scanning conditions are as following:

Condition of Test	Remark
1. Fielded Strength	10V/m(level 3)
2. Radiated Signal	Modulated
3. Scanning Frequency	80-1000MHz
4. Sweep time of radiated	0.0015 Decade/s
5. Dwell Time	1 Sec.

8.7. Test Results

PASS.

Please refer to the following page.

RF Field Strength Susceptibility Test Results

EMTEK(SHENZHEN) CO., LTD..

Applicant	: INVT POWER SYSTEM (SHENZHEN) CO., LTD.		Test Date	: June 09, 2015	
EUT	: Uninterruptible Power Systems		Temperature	: 22°C	
M/N	: HT33120X		Humidity	: 50%	
Field Strength	: 10V/m		Actual Criterion	: A	
Power Supply	: AC 380V/50Hz		Test Mode	: Line mode, Battery mode	
Test Engineer	: YU		Frequency Range	: 80 to 1000 MHz	
Modulation:	<input type="checkbox"/> None		<input type="checkbox"/> Pulse	<input checked="" type="checkbox"/> AM 1KHz 80%	
	Frequency Rang 1: 80~ 1000MHz		Frequency Rang 2: N/A		
Steps	#	/	%	#	/
	Horizontal	Vertical		Horizontal	Vertical
Front	A	A			
Right	A	A			
Rear	A	A			
Left	A	A			
Test Equipment :					
1. Signal Generator : N5181A (Agilent)					
2. Power Amplifier : 80RF1000-175 (MILMEGA) & AS1860-50 (MILMEGA)					
3. Log.-Per.Antenna: VULP9118E (SCHWARZBECK)					
4 RF Power Meter. Dual Channel: 4232A (BOONTON)					
5 Field Strength Meter: RSS1006A (DARE)					
Note: /					

9. ELECTRICAL FAST TRANSIENT/BURST IMMUNITY TEST

9.1. Block Diagram of Test Setup


9.1.1. Block Diagram of the EUT



(EUT: Uninterruptible Power Systems)

9.1.2. EFT Test Setup

AC Port:

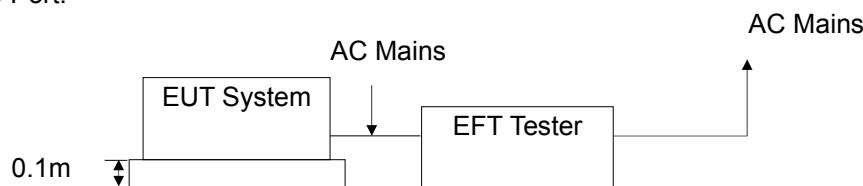

(EUT: Uninterruptible Power Systems)

9.2. Test Standard

IEC 61000-4-4:2012 (Level 3: 2kV/5kHz for AC Mains)

9.3. Severity Levels and Performance Criterion

9.3.1. Severity level

Open Circuit Output Test Voltage ±10%		
Level	On Power Supply Lines	On I/O (Input/Output) Signal data and control lines
1.	0.5 kV	0.25 kV
2.	1 kV	0.5 kV
3.	2 kV	1 kV
4.	4 kV	2 kV
X	Special	Special

9.3.2. Performance criterion : B

	Criterion B
Output characteristics	Voltage permitted to vary within the inverse time characteristics applicable (<100 m sec limits in Figures 1, 2 or 3 of IEC 62040-3)
External and internal indications and metering	Change only during test
Control signals to external devices	Change only temporarily in consistency with the actual Uninterruptible Power Systems mode of operation
Mode of operation	Change only temporarily

9.4. EUT Configuration

The configuration of EUT is listed in Section 4.4.

9.5. Operating Condition of EUT

- 9.5.1. Setup the EUT as shown in Section 9.1.
- 9.5.2. Turn on the power of all equipments.
- 9.5.3. Let the EUT work in test mode (Line mode) and measure it.

9.6. Test Procedure

The EUT is put on the table which is 0.1m high above the ground. This reference ground plane shall project beyond the EUT by at least 0.1m on all sides and the minimum distance between EUT and all other conductive structure, except the ground plane beneath the EUT, shall be more than 0.5m.

- 9.6.1. For input and output AC power ports:

The EUT is connected to the power mains by using a coupling device which couples the EFT interference signal to AC power lines. Both polarities of the test voltage should be applied during compliance test and the duration of the test is 2 mins.

- 9.6.2. For signal line and control lines ports:

It's unnecessary to test.

- 9.6.3. For DC output line ports:

It's unnecessary to test.

9.7. Test Result

PASS.

Please refer to the following page.

Electrical Fast Transient/Burst Test Results

EMTEK(SHENZHEN) CO., LTD..

Standard	IEC 61000-4-4	Result: <input checked="" type="checkbox"/> PASS / <input type="checkbox"/> FAIL			
Applicant : INVT POWER SYSTEM (SHENZHEN) CO., LTD.					
EUT : Uninterruptible Power Systems					
M/N : HT33120X					
Input Voltage : AC 380V/50Hz					
Actual Criterion : B					
Ambient Condition : 23 °C		55% RH			
Operation Mode: Line mode					
Line : <input checked="" type="checkbox"/> AC input and output power ports		Line : <input type="checkbox"/> Signal <input type="checkbox"/> I/O Cable			
Coupling : <input checked="" type="checkbox"/> Direct		Coupling : <input type="checkbox"/> Capacitive			
Test Time : 120s					
Line	Test Voltage	Result(+)	Result(-)		
AC input power ports: L1, L2, L3, N, PE	2KV	A	A		
L1-L2, L1-L3, L2-L3, L1-N, L2-N, L3-N	2KV	A	A		
L1-PE, L2-PE, L3-PE, N-PE	2KV	A	A		
L1-L2-PE, L1-L3-PE, L2-L3-PE, L1-L2-L3, L1-L2-N, L1-L3-N, L2-L3-N, L1-N-PE, L2-N-PE, L3-N-PE	2KV	A	A		
L1-L2-L3-PE, L1-L2-L3-N, L1-L2-N-PE, L1-L3-N-PE, L2-L3-N-PE	2KV	A	A		
AC output power ports: L1, L2, L3, N, PE	2KV	A	A		
L1-L2, L1-L3, L2-L3, L1-N, L2-N, L3-N	2KV	A	A		
L1-PE, L2-PE, L3-PE, N-PE	2KV	A	A		
L1-L2-PE, L1-L3-PE, L2-L3-PE, L1-L2-L3, L1-L2-N, L1-L3-N, L2-L3-N, L1-N-PE, L2-N-PE, L3-N-PE	2KV	A	A		
L1-L2-L3-PE, L1-L2-L3-N, L1-L2-N-PE, L1-L3-N-PE, L2-L3-N-PE	2KV	A	A		
DC line					
Signal line					
Note:					
Test Equipment		Burst Tester Model : PEFT 4010			

10. SURGE IMMUNITY TEST


10.1. Block Diagram of Test Setup

10.1.1. Block Diagram of the EUT



(EUT: Uninterruptible Power Systems)

10.1.2. Surge Test Setup

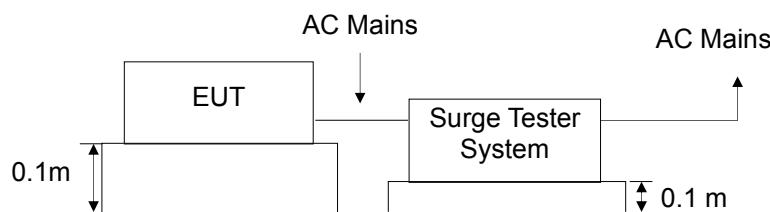

(EUT: Uninterruptible Power Systems)

10.2. Test Standard

IEC 61000-4-5:2014 (Line to Line: Level 2, 1.0kV, Line to earth: Level 3, 2.0kV)

10.3. Severity Levels and Performance Criterion

10.3.1. Severity level

Severity Level	Open-Circuit Test Voltage kV
1	0.5
2	1.0
3	2.0
4	4.0
*	Special

10.3.2. Performance criterion: B

	Criterion B
Output characteristics	Voltage permitted to vary within the inverse time characteristics applicable (<100 m sec limits in Figures 1, 2 or 3 of IEC 62040-3)
External and internal indications and metering	Change only during test
Control signals to external devices	Change only temporarily in consistency with the actual Uninterruptible Power Systems mode of operation
Mode of operation	Change only temporarily

10.4.EUT Configuration

The configuration of EUT is listed in Section 4.3.

10.5.Operating Condition of EUT

- 10.5.1.Setup the EUT as shown in Section 10.1.
- 10.5.2.Turn on the power of all equipments.
- 10.5.3.Let the EUT work in test mode (Line mode) and measure it.

10.6.Test Procedure

- 1) Set up the EUT and test generator as shown on Section 10.1.2.
For line to line coupling mode, provide 1kV 1.2/50us voltage surge.
For line to earth mode, provide 2kV 1.2/50us voltage surge.
(At open-circuit condition) and 8/20us current surge to EUT selected points.
- 2) At least 5 positive and 5 negative (polarity) tests with a maximum 1/min repetition rate are conducted during test.
- 3) Different phase angles are done individually.
- 4) Record the EUT operating situation during compliance test and decide the EUT immunity criterion for above each test.

10.7.Test Result

PASS.

Please refer to the following page.

Surge Immunity Test Result

EMTEK(SHENZHEN) CO., LTD..

Applicant : INVT POWER SYSTEM (SHENZHEN) CO., LTD.

Test Engineer: YU

EUT : Uninterruptible Power Systems

Test Date : June 09, 2015

M/N : HT33120X

Temperature : 23°C

Power Supply : AC 230V / 50Hz

Humidity : 51%

Test Mode : Line mode

Criterion : B


Location	Polarity	Phase Angle	Number of Pulse	Pulse Voltage (kV)	Result
AC Input: L1-L2, L1-L3, L2-L3	+	0°, 90°, 180°, 270°	5	1.0	A
	-	0°, 90°, 180°, 270°	5	1.0	A
L1-N, L2-N, L3-N	+	0°, 90°, 180°, 270°	5	1.0	A
	-	0°, 90°, 180°, 270°	5	1.0	A
L1-PE, L2-PE, L3-PE	+	0°, 90°, 180°, 270°	5	2.0	A
	-	0°, 90°, 180°, 270°	5	2.0	A
N-PE	+	0°, 90°, 180°, 270°	5	2.0	A
	-	0°, 90°, 180°, 270°	5	2.0	A
AC Output: L1-L2, L1-L3, L2-L3	+	Random	5	1.0	A
	-	Random	5	1.0	A
L1-N, L2-N, L3-N	+	Random	5	1.0	A
	-	Random	5	1.0	A
L1-PE, L2-PE, L3-PE	+	Random	5	2.0	A
	-	Random	5	2.0	A
N-PE	+	Random	5	2.0	A
	-	Random	5	2.0	A

Note:


11. INJECTED CURRENTS SUSCEPTIBILITY TEST

11.1. Block Diagram of Test Setup

11.1.1. Block Diagram of the EUT

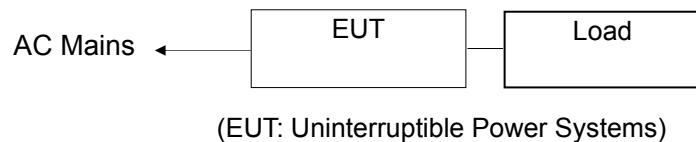

11.1.2. Block Diagram of Test Setup

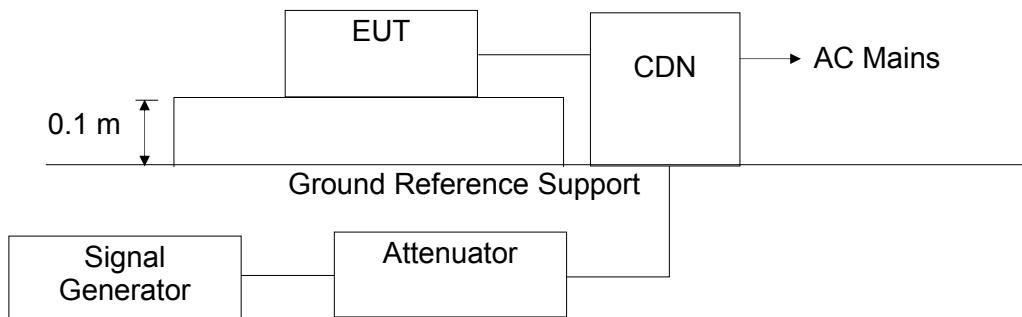

11.2. Test Standard

IEC 61000-4-6:2013 (Level 3: 10V (rms) (0.15MHz ~ 80MHz))

11.3. Severity Levels and Performance Criterion

11.3.1. Severity level

Level	Field Strength V
1	1
2	3
3	10
X	Special

11.3.2. Performance criterion: A

	Criterion A
External and internal indications and metering (LCD)	No change
Output characteristics (Load)	No change
Control signals to external devices (Signal line)	No change
Mode of operation	No change

11.4.EUT Configuration

The configuration of EUT is listed in Section 4.3.

11.5.Operating Condition of EUT

- 11.5.1.Setup the EUT as shown in Section 11.1.
- 11.5.2.Turn on the power of all equipments.
- 11.5.3.Let the EUT work in test mode (Line mode) and measure it.

11.6.Test Procedure

- 1) Set up the EUT, CDN and test generators as shown on Section 13.1.2.
- 2) Let the EUT work in test mode and measure it.
- 3) The EUT are placed on an insulating support 0.1m high above a ground reference plane. CDN (coupling and decoupling device) is placed on the ground plane about 0.3m from EUT. Cables between CDN and EUT are as short as possible, and their height above the ground reference plane shall be between 30 and 50 mm (where possible).
- 4) The disturbance signal described below is injected to EUT through CDN.
- 5) The EUT operates within its operational mode(s) under intended climatic conditions after power on.
- 6) The frequency range is swept from 150KHz to80MHz using 10V signal level, and with the disturbance signal 80% amplitude modulated with a 1KHz sine wave.
- 7) The rate of sweep shall not exceed 1.5×10^{-3} decades/s. Where the frequency is swept incrementally, the step size shall not exceed 1% of the start and thereafter 1% of the preceding frequency value.
- 8) Recording the EUT operating situation during compliance testing and decide the EUT immunity criterion.

11.7.Test Results

PASS.

Please refer to the following page.

Injected Currents Susceptibility Test Results

EMTEK(SHENZHEN) CO., LTD..

Applicant : <u>INVT POWER SYSTEM (SHENZHEN) CO., LTD.</u>	Test Date : <u>June 09, 2015</u>			
EUT : <u>Uninterruptible Power Systems</u>	Temperature : <u>23°C</u>			
M/N : <u>HT33120X</u>	Humidity : <u>50%</u>			
Power Supply : <u>AC 380V/50Hz</u>	Actual Criterion : A			
Test Engineer : <u>YU</u>				
Test Mode : Line mode				
Frequency Range (MHz)	Injected Position	Strength (Unmodulated)	Criterion	Result
0.15 ~ 80	AC Input	10V	A	A
0.15 ~ 80	AC Output	10V	A	A
Remark : 1. Modulation Signal:1KHz 80% AM Measurement Equipment : Simulator: CIT-10 CDN : <input type="checkbox"/> CDN-M332 <input type="checkbox"/> CDN-M432 <input checked="" type="checkbox"/> CDN-M532		Note: /		

12. MAGNETIC FIELD SUSCEPTIBILITY TEST


12.1. Block Diagram of Test

12.1.1. Block diagram of test setup



(EUT: Uninterruptible Power Systems)

12.1.2. Magnetic field test setup

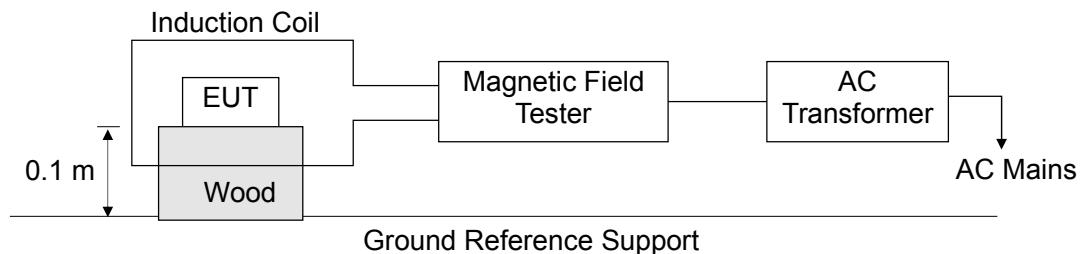

(EUT: Uninterruptible Power Systems)

12.2. Test Standard

IEC 61000-4-8:2009, (Severity Level 4: 30A / m)

12.3. Severity Levels and Performance Criterion

12.3.1. Severity Levels

Level	Field Strength A/m
1	1
2	3
3	10
4	30
5	100
X	Special

12.3.2.Performance Criterion: A

	Criterion A
Output characteristics	Voltage permitted to vary within the inverse time characteristics applicable (<100 m sec limits in Figures 1, 2 or 3 of IEC 62040-3)
External and internal indications and metering	Change only during test
Control signals to external devices	Change only temporarily in consistency with the actual Uninterruptible Power Systems mode of operation
Mode of operation	Change only temporarily

12.4.EUT Configuration on Test

The configuration of the EUT is same as Section 4.3.

12.5.Test Procedure

The EUT is placed in the middle of a induction coil, under which is a 0.1m (high) table, this small table is also placed on a larger table, 0.8 m above the ground. Both horizontal and vertical polarization of the induction coil is set on test, so that each side of the EUT is affected by the magnetic field. Also can reach the same aim by change the position of the EUT.

12.6.Test Results

PASS.

Please refer to the following page.

Magnetic Field Immunity Test Result

EMTEK(SHENZHEN) CO., LTD..

Standard	IEC 61000-4-8			Result: <input checked="" type="checkbox"/> Pass / <input type="checkbox"/> Fail
Applicant : INVT POWER SYSTEM (SHENZHEN) CO., LTD. EUT : Uninterruptible Power Systems M/N : HT33120X Input Voltage : AC 380V/50Hz Date of Test : June 09, 2015 Test Engineer : YU Ambient Condition : Temp : 22°C Humid : 50% Actual Criterion : A				
Operation Mode : Line mode				
Test Level (A/M)	Testing Duration	Coil Orientation	Criterion	Result
30	5 mins	X	A	A
30	5 mins	Y	A	A
30	5 mins	Z	A	A
Operation Mode : N/A				
Test Level (A/M)	Testing Duration	Coil Orientation	Criterion	Result
Test Equipment	Magnetic Field Test : HEAFELY MAG 100.1			
Note: /				

13. VOLTAGE DIPS AND INTERRUPTIONS TEST


13.1. Block Diagram of Test Setup

13.1.1. Block Diagram of the EUT



(EUT: Uninterruptible Power Systems)

13.1.2. Dips Test Setup

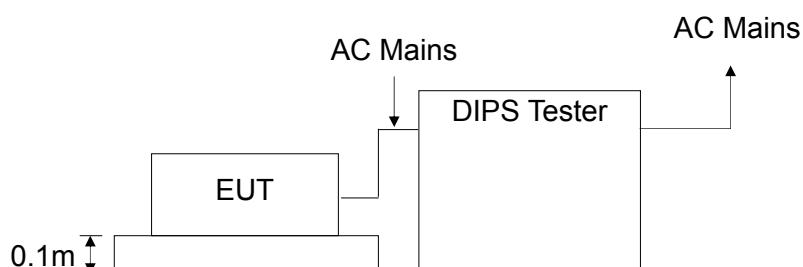

(EUT: Uninterruptible Power Systems)

13.2. Test Standard

IEC 61000-4-11:2004

13.3. Severity Levels and Performance Criterion

13.3.1. Severity level

Test Level %UT	Voltage dip and short interruptions %UT	Duration (in period)
0	100	0.5 1 5 10 25 50 *
40	60	
70	30	

13.3.2.Performance criterion: B

	Criterion B
Output characteristics	Voltage permitted to vary within the inverse time characteristics applicable (<100 m sec limits in Figures 1, 2 or 3 of IEC 62040-3)
External and internal indications and metering	Change only during test
Control signals to external devices	Change only temporarily in consistency with the actual Uninterruptible Power Systems mode of operation
Mode of operation	Change only temporarily

13.4.EUT Configuration

The configuration of EUT is listed in Section 4.3.

13.5.Operating Condition of EUT

13.5.1.Setup the EUT as shown in Section 13.1.

13.5.2.Turn on the power of all equipments.

13.5.3.Let the EUT work in test mode (Line mode) and measure it.

13.6.Test Procedure

- 1) Set up the EUT and test generator as shown on Section 13.1.2.
- 2) The interruption is introduced at selected phase angles with specified duration.
- 3) Record any degradation of performance.

13.7.Test Result

PASS.

Please refer to the following page.

Voltage Dips And Interruptions Test Results

EMTEK(SHENZHEN) CO., LTD..


Applicant : <u>INVT POWER SYSTEM (SHENZHEN) CO., LTD.</u>	Test Date : <u>June 09, 2015</u>			
EUT : <u>Uninterruptible Power Systems</u>	Temperature : <u>22°C</u>			
M/N : <u>HT33120X</u>	Humidity : <u>50%</u>			
Power Supply : <u>AC 380V/50Hz</u>	Test Engineer : <u>YU</u>			
Test Mode: Line mode				
Test Level % U _T	Voltage Dips & Short Interruptions % U _T	Duration (in periods)	Criterion <input type="checkbox"/> A <input checked="" type="checkbox"/> B <input type="checkbox"/> C <input type="checkbox"/> D	Result
0	100	0.5P	B	A
0	100	1P	B	A
70	30	25P	B	A
0	100	250P	B	B
Note: Test in 0%, 250P, light appears flicker, but can self-recovery.				

14. TEST PHOTOGRAPH


14.1.Photos of Conducted Emission Measurement



14.2.Photo of Radiation Emission Measurement

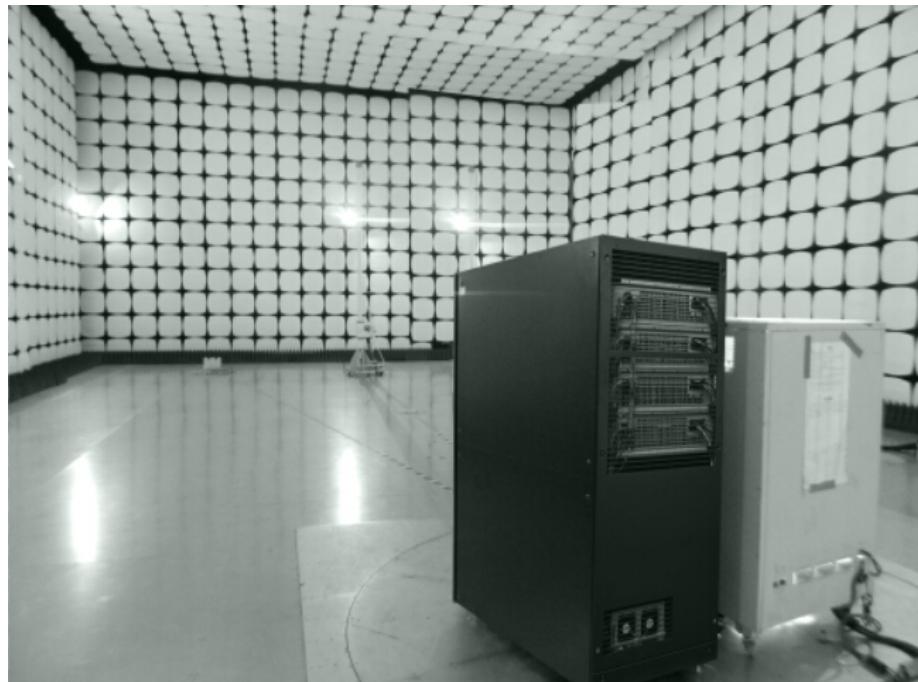

14.3.Photo of Electrostatic Discharge Test

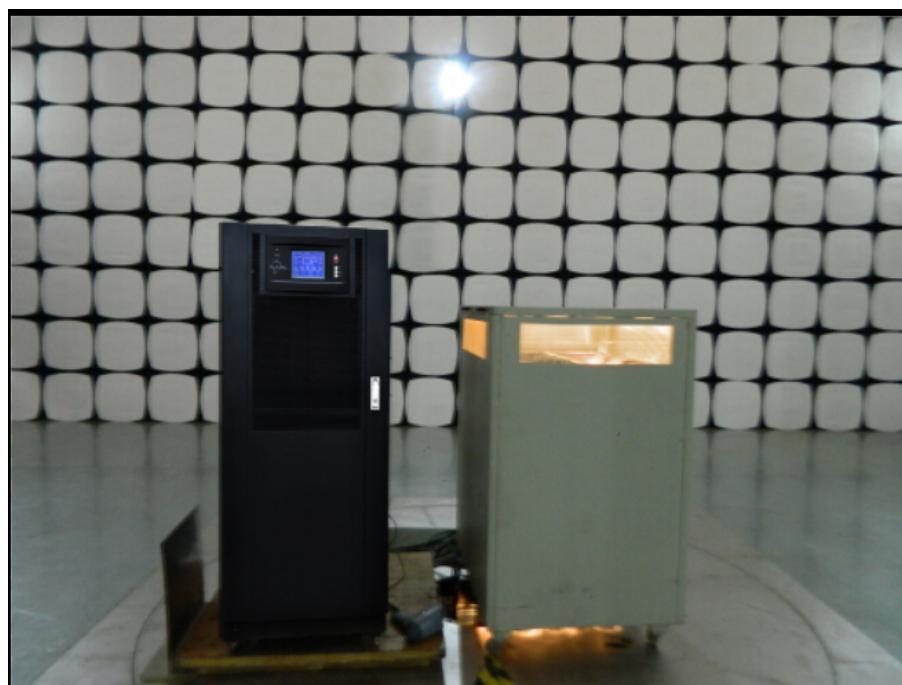

14.4.Photo of RF Field Strength susceptibility Test



14.5.Photos of Electrical Fast Transient/Burst Test



14.6.Photo of Surge Test



14.7.Photo of Injected Currents Susceptibility Test



14.8.Photo of Magnetic Field Immunity Test



14.9.Photo of Voltage dips and interruption Test



APPENDIX (Photos of EUT)



