

5. Specification

5.1 Electrical Performance Input

Items		Parameters		
		2000VA / 3000VA		4000VA / 5000VA
		Inverter mode UPS mode		
Rating	Input voltage	220VAC		
	Input frequency	50Hz		
	Input phase	Single phase		
Input voltage range		120V~300VAC	145V~285VAC	160V~265VAC 190V~260VAC
Input Frequency range		38~70HZ		

Output

Items	Parameter	Model			
		2000VA	3000VA	4000VA	5000VA
Output voltage	Utility mode	UPS: 190V~260V / INV: 160V~260V			
	Battery mode	220V±10%			
Output frequency	Utility mode	Same as Utility			
	Battery mode	50HZ±1HZ			
Wave	Utility mode	Tracking Utility			
	Battery mode	Sine wave			
PF of output		0.8			
Output Power		2000VA / 1600W	3000VA / 2400W	4000VA / 3200W	5000VA / 4000W
Protection		Overload / short circuit / overheat			

Overload capability

Utility mode:

- 1) Inverter to normal operation, when 100% load
- 2) over load (100~120%), 3 minute the inverter shut down, after shut down, then restart automatically after 30 seconds. Automatic restart 3times, if the inverter still overload, the inverter will enter the fault mode, next restart by people.
- 3) over load (120~130%), 30 sec the inverter shut down, after shout down, then restart automatically after 30 seconds. Automatic restart 3times, if the inverter still overload, the inverter will enter the fault mode, next restart by people.
- 4) overload ($\geq 130\%$), the inverter immediate closure of the output, then restart automatically after 30 seconds. Automatic restart 3times, if the inverter still overload, the inverter will enter the fault mode, next restart by people.

Battery mode:


- 1) Inverter to normal operation, when 100% load.
- 2) over load (100~110%), 10 sec the inverter shut down, after shout down, then restart automatically after 30 seconds. Automatic restart 3times, if the inverter still overload, the inverter will enter the fault mode, next restart by people.
- 3) overload ($\geq 110\%$), the inverter immediate closure of the output, then restart automatically after 30 seconds. Automatic restart 3times, if the inverter still overload, the inverter will enter the fault mode, next restart by people.

1. Introduction

This series inverters are intelligent one phase in/one phase out sinewave output inverter power supplies. It is specially designed to meet the requirements of those family and office environment with unstable utility, frequent power down. It features CPU intelligent control, wide input voltage range, fast battery charge speed, good appearance and high reliability, etc. It is widely used with appliance and office equipment such as TV set, DVD player, electric driller, refrigerator, recorder, water machine, fan, lighting, switchboard, servers, etc. The capacity range is from 2000VA to 5000VA.

2. Parts names and functions

2.1 Front panel

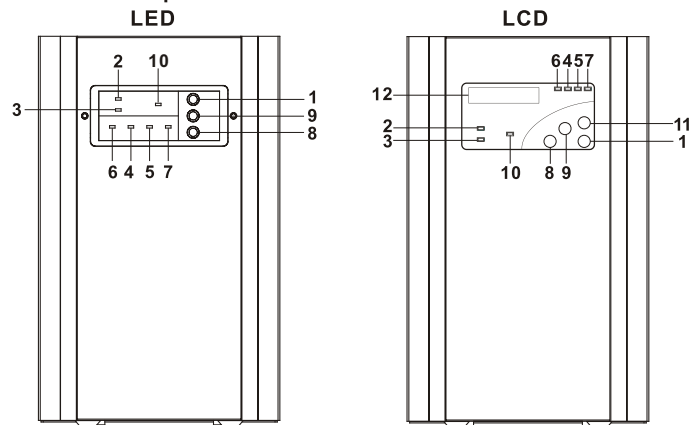


Description:

No	Function	Description	Remark
1	power on/off	inverter is power on when switch button is "on", inverter is off when switch button is "off"	Battery mode works when switch button is "on" and battery is in normal condition
2	utility indication LED light	LED is on, which means input is normal, load is powered by utility	
3	inverter indication LED light	LED is on, which means load is powered by battery through inverter	LED light is on, beep once every 10 seconds, beep is stopped after 3 minutes
4	battery charge indication LED light	LED is on, which means system is charging battery	
5	battery charging full indication LED light	LED is on, which means battery charging is finished	

6	Battery low indication LED light	LED is on, which means battery is low.	
7	Trouble/ overload/ overheat/ low battery indication LED light	LED is on ,which means inverter does not work normally, telling the states of inverter is Trouble/ overload/overheat/ low battery according to the audible alarm	Beep 2 times every 1 second means low battery; beep 4 times every 2 seconds means overload, beep 3 times every 1 second means inverter is overheat, keeping beep means ups has trouble ,for example, output short circuit, inverter trouble, hardware trouble.
8	switch button for ups and inverter option	Choose to work in UPS or inverter mode	When choosing UPS mode , typical transfer time is 10ms , all is less than 15ms, some kind pc load may not be protected from restart when utility off.
9	charging current option switch button	charging current is set according to battery capacity	Charging current setup according to manufacturer parameter
10	Output indication LED light	LED is on, output ingear.	
11	PAGE		
12	LCD		


2.2 Back panel



2000VA/ 3000VA

Explanation:

- 1--- utility input seat
- 2--- utility input fuse
- 3--- output socket
(the socket type is optional, subject to the actual machine)
- 4--- battery switch
(work status is switch on)
- 5--- battery negative junction pole (black)
- 6--- battery positive junction pole (red)
- 7--- fan(work automatically when the temperature within equipment is over 50°C)



4000VA/ 5000VA

Explanation:

- 1---input switch
- 2---Battery switch
- 3---GND
- 4---Fan
- 5---Output
- 6---Input
- 7---Battery positive junction pole (red)
- 8---Battery negative junction pole (back)
- 9---RS232 reserved

OUTPUT SOCKET TYPE	
	IEC SOCKET
	CHINESE STANDARD SOCKET
	UNIVERSAL SOCKET
	GERMANY STANDARD SOCKET

3. Installation and operation

3.1 Unpack

When open the pack, please check the appearances of packing and inverter, If there are damage, please inform reseller immediately and keep packing for future delivery.

3.2 Location

The inverter should be put on flat ground where is dry without direct light and corrosive air. Please keep at least 10cm distance from the inverter to other articles in 4 sides to achieve good thermal dissipation. Please do not put anything on the inverter.

3.3 Wiring

(1). Connect battery with inverter input terminals correctly; Positive line(red) should be connected with battery positive pole, battery negative line(black) should be connected with battery negative pole, Please note battery voltage should match with the unit's rate voltage.

(2). Switch off the battery.

(3). Put the inverter input plug into the utility socket.

(4). Put load power cable plug into the inverter output socket.

Please note the total load capacity must be less than unit's rate capacity.

3.4 Switch on

When all cable connections are confirmed correct, please press the power button, unit could work. When utility is normal, utility indication LED light and battery charging indication LED light are ON; When utility is abnormal, utility is off(utility input plug is not in place), then inverter indication LED light is ON.

3.5 Switch off

1). Switch off all loads

2). Power button on front panel is off

3). Plug off utility socket

4). Battery switch is off

4. Audible Alarm Instruction

Sounds	Indication
Once/10sec, auto-eliminated after 3 minutes.	Battery mode
Twice/2sec	Low battery
Continually 4 times/2sec	Output overload
Continually sounds/2sec	UPS On
3 times/1sec	Inverter over temperature
Continually Ringing	Output short circuit//Inverter damaged, abnormal/hardware failure, etc.